

P O S I S T R U T S

MiTek

GUIDELINES

for the DESIGN, FIXING

and BRACING of

PosiStrut

FLOOR & ROOF

truss systems



2012 - ISSUE 1



HOME OF GANG-NAIL BUILDING SYSTEMS

creating the **advantage**

VIC (03) 8795 8888 NSW (02) 8525 8000 QLD (07) 3861 2100 SA (08) 8234 1326 WA (08) 6218 5945 NZ (09) 274 7109 MALAYSIA (603) 3176 7473

TABLE OF CONTENTS


PosiStrut® Floor Truss System

Introduction	3
Advantages	3
Definitions	3
Floor Stiffness	3
Floor Loading	3
Residential Load Span Charts for Bottom Chord Support	4
Residential Load Span Charts for Top Chord Support	4
Commercial Load Span Charts for Bottom Chord Support	5
Supporting Structure	6
Handling and Storage	6
Set Out and Placement	7
Trimming On Site	7
Supporting External Walls	7
Supported Non-Load Bearing Walls	9
Support Details	10
Fixing and Connections	11
Strongbacks	13
Stair Openings	15
Cantilevers	17
Bracing	19
Mechanical Services	20


PosiStrut® Roof Rafter & Purlin System

Introduction	21
Definition	21
Roof Loading/Camber	21
Set Out	21
Sizes	21
Hold Down Details	21
Bracing	22
Span Charts	23
Speedbrace Fixing	26


PosiTruss

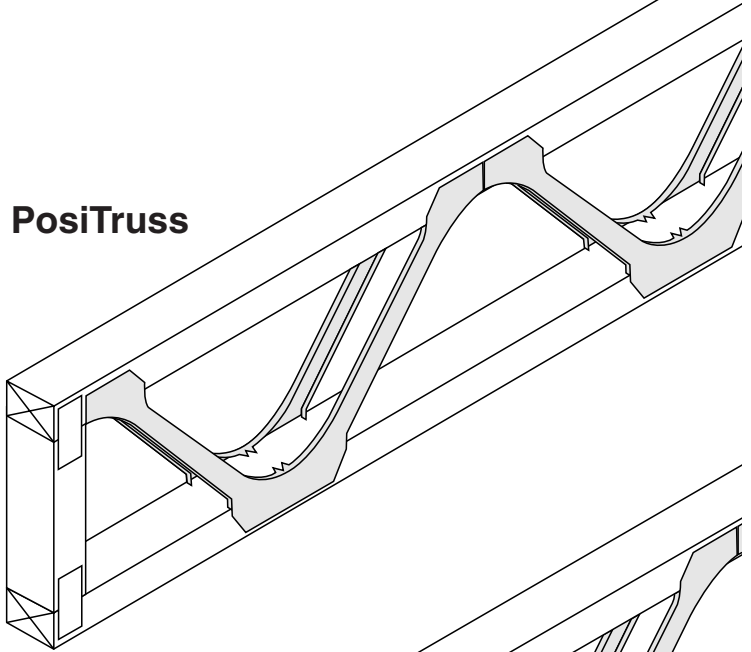

PosiJoist

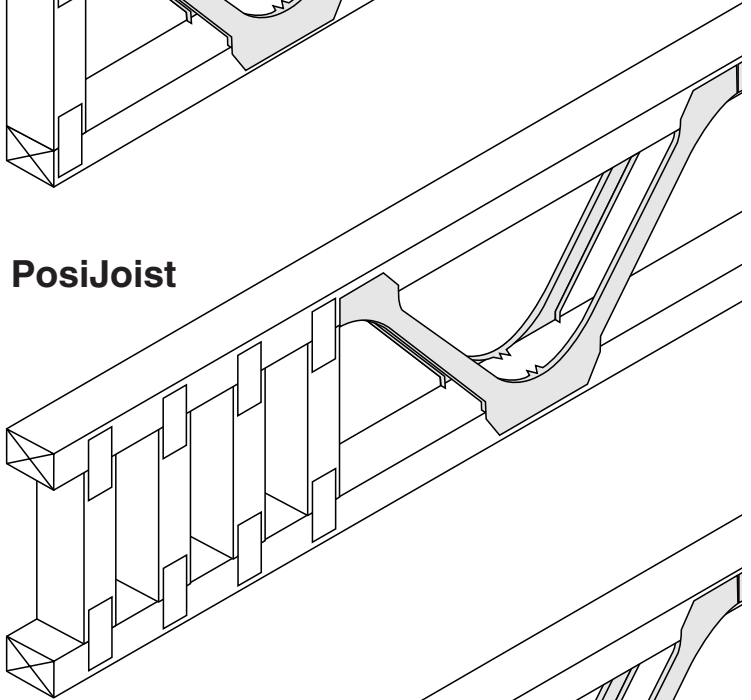

PosiPlus

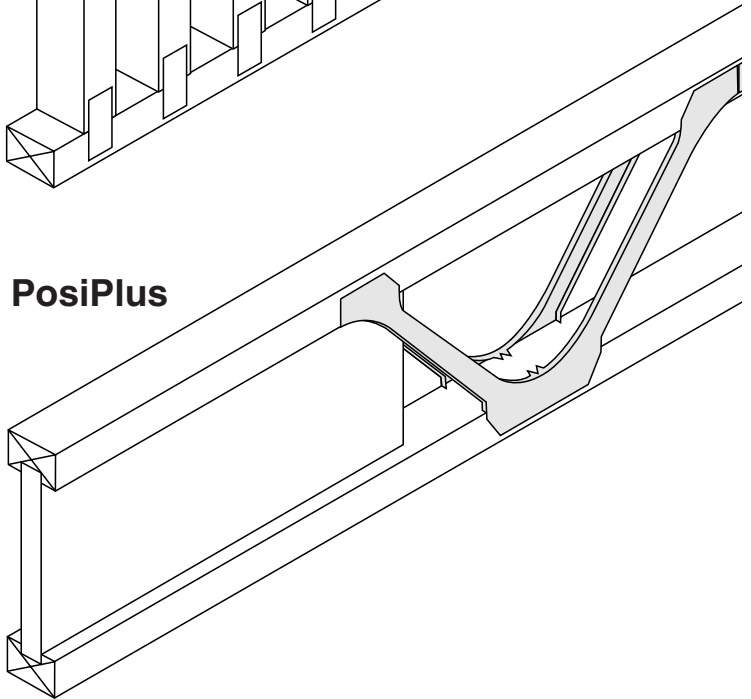

PosiStrut® Floor System

INTRODUCTION

PosiStrut® range of products are parallel chord trusses using timber chords “on flat” and the unique PosiStrut® metal webs.

PosiTruss is a made to order parallel chorded truss commonly used as long span floor joists. They provide an economical and high quality floor structure which is easily assembled and provides excellent access for plumbing, electrical services and air conditioning ducts. PosiTruss may also be used for long span rafters or purlins to carry tile or steel deck roofing.

As PosiTrusses are designed and manufactured to order for specific projects, they can incorporate internal beams and special support conditions.

PosiJoist® and PosiPlus® trusses incorporate special trimmable ends and are available ex stock. PosiJoist® and PosiPlus® are designed specifically for use as floor joists in domestic type structures and should not be used for other applications without advice from a qualified engineer.

The PosiStrut® range of products are available in nominal 200, 250, 300, 360 and 400mm depth. Actual overall truss depth depends on timber sizes used for the chords, and is provided in the design tables enclosed. PosiStruts® make more efficient use of timber than conventional joists, as they have timber concentrated at the top and bottom of the truss where it works most efficiently. This concept is similar to that of steel universal beams, where the majority of steel is located in the flanges. The efficient use of timber, combined with the strength of the PosiStrut® webs, make the PosiStrut® range of products very lightweight, yet strong structural members.

ADVANTAGES

PosiStruts® offer the following advantages over solid joists:

- Plumbing, electrical conduit and other services can be run between chords and webs.
- No drilling or notching required to accommodate services.
- Additional width available for fixing flooring.
- Ceiling material can be fixed directly to the truss bottom chords.
- Larger clear spans.
- Internal load bearing walls, piers or stumps and bearers can be reduced or eliminated.
- Shrinkage problems sometimes encountered with unseasoned solid timber are reduced or eliminated.
- Lightweight and easy to handle.
- PosiJoist® and PosiPlus® trusses may be trimmed to length on site.
- Load sharing ability.
- Strongback bracing increases floor stiffness and reduces squeaky floors.
- Optional top chord support reduces on-site labour.
- With Posi-Purlins, roof and ceiling can be fixed direct.
- Top chord hanging.

DEFINITIONS

Loadbearing Partition Walls - walls which carry roof and/or upper floor loads in addition to their own self weight and wall lining.

Non-Load bearing Partition Walls - walls which impart self weight only to supporting structure.

Platform Flooring - flooring fitted continuously from external wall to external wall prior to the installation of internal partition walls.

Fitted Flooring - flooring fitted for each room after internal walls have been installed.

Strongbacks - bracing members running at right angles to PosiStruts® which provide load sharing between adjacent members.

FLOOR STIFFNESS

The dynamic response of floor systems to foot traffic and other moving loads is dependant on many factors such as the floor plan of supported walls, applied load, furniture layout, etc. The comfort and expectations of occupants also varies widely and is very personal.

PosiStruts® have been designed so that the maximum span recommended in Tables 1 to 8 conforms to the vibration standard set out in AS1684.1, Residential Timber-Framed Construction, Part 1 - design criteria.

When selecting a PosiStrut® for your application consideration should be given to the springiness of the floor. Generally the floor stiffness provided by the Tables meets the expectations of most occupants. Where PosiStruts® are near their maximum span for large open areas like rumpus rooms and family rooms, or where additional floor stiffness is required the maximum spans given in Tables 1 to 8 should be reduced.

FLOOR LOADING

PosiStruts® have been designed for the following loads.

Dead Loads - are due to the mass of the structure and permanent fixtures. An allowance has been made in these designs for the following permanent loads:

Flooring - 22mm particle board flooring or equivalent plywood.

Ceiling - 13mm plasterboard direct or 10 mm plasterboard on battens.

Floor covering - normal floor covering loads e.g. carpets or vinyl tiles. If, clay or heavy ceramic tiles are to be used, on large areas (i.e. greater than 3 square metres), further professional advice should be sought before commencing construction.

Live Loads - are temporary loads due to furniture or people which may vary over time.

PosiStrut® floor systems in this manual have been designed for the following live loads:

Domestic floors = 1.5kPa / 1.8kN

Hospital wards and hotel rooms = 2.0kPa / 1.8kN

Offices for general use = 3.0kPa / 2.7kN

Assembly areas without seating such as concert halls, bars, public lounges = 5.0kPa / 3.6kN


Note: 1. The PosiStrut® span chart in the tables, are not designed to support load bearing walls. All roof loads to be supported by external wall only. For PosiStruts® that must support load bearing walls, contact your nearest MiTek office.

2. Minimum Joint Group JD5.

Earthquake Loads - the PosiStrut® sizes, bracing and connection details are suitable for design category H1 and H2 domestic structures in accordance with AS1170.4.

RESIDENTIAL LOADS

SPAN CHARTS FOR BOTTOM CHORD SUPPORT FLOOR TRUSSES

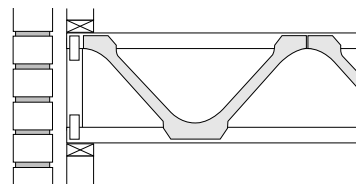

Maximum Spans for 35mm thick timber

Table 1. Maximum Spans for Domestic Floor Loads - Live Load 1.5 kPa														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW3520	35 x 70	197	1100	3800	4400	3400*	4300	4600	-	3400	4000	3100*	3800	4000
	35 x 90	197	3800	4200	4800	4000	4600	4900	3300	3800	4300	3400	4200	4300
PSW3525	35 x 70	248	1100	4600	5200	4100*	5100	5300	1100	4200	4800	3400*	4500	4900
	35 x 90	248	4500	5000	5500	4600	5400	5700	3900	4600	5100	4000	4800	5200
PSW3530	35 x 70	302	1100	5300	5800	4500*	5700	5900	1100	4800	5400	4000*	4900	5500
	35 x 90	302	5000	5600	6200	5200	6100	6300	4400	5200	5800	4500	5600	5900


*Important Note: For spans in the range of 1100 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1

Maximum Spans for 45mm thick timber

Table 2. Maximum Spans for Domestic Floor Loads - Live Load 1.5 kPa															
Posi Strut® Size	Posi Joist® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
				Timber Grade											
				F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW4525	PJ25-70	45 x 70	248	4400	4900	5400	4500	5300	5500	3800	4400	5000	3900	4900	5100
	PJ25-90	45 x 90	248	4900	5200	5800	5100	5600	5900	4300	4800	5400	4500	5200	5500
PSW4530	PJ30-70	45 x 70	302	4900	5500	6100	5100	6000	6200	4300	5100	5700	4500	5500	5800
	PJ30-90	45 x 90	302	5500	5800	6500	5700	6300	6600	4800	5400	6000	5000	5900	6100
PSW4536	-	45 x 70	360	5500	6000	6700	5600	6500	6900	4700	5600	6200	4900	6100	6300
	-	45 x 90	360	6000	6400	7100	6400	7000	7200	5400	6000	6600	5600	6500	6700
PSW4540	PJ40-70	45 x 70	412	5900	6500	7200	6100	7100	7400	5100	6100	6700	5400	6600	6900
	PJ40-90	45 x 90	412	6500	6900	7700	6900	7500	7900	5600	6400	7100	6000	7000	7300

SPAN CHARTS FOR TOP CHORD SUPPORT FLOOR TRUSSES

Note: Spans have been produced for 45mm wide top chord bearings.

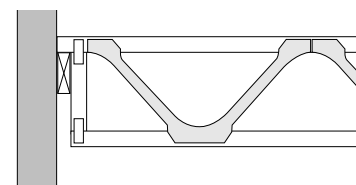

Maximum Spans for 35mm thick timber

Table 3. Maximum Spans for Domestic Floor Loads - Live Load 1.5 kPa														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW3520	35 x 70	197	-	3900	4500	-	4100	4500	-	3000#	3900	-	3700	3900
	35 x 90	197	-	4100	4700	4000	4500	4700	-	3700	4000	-	4000	4000
PSW3525	35 x 70	248	-	4100	5100	-	5000	5200	-	3100#	4800	-	4500	4700
	35 x 90	248	-	4900	5500	4600*	5300	5600	-	3900	5000	3900*	4900	5200
PSW3530	35 x 70	302	-	4100	5700	-	5600	5700	-	3100#	5300	-	4900	5300
	35 x 90	302	-	5200	6100	5200*	6000	6200	1100	3900	5700	4100*	5400	5800

*Important Note: For spans in the range of 1100 to 2600, top chords should be a minimum grade of F11 or MGP12 to conform to AS1720.1

#Important Note: For spans in the range of 1100 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1


Maximum Spans for 45mm thick timber

Table 4. Maximum Spans for Domestic Floor Loads - Live Load 1.5 kPa														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW4525	45 x 70	248	4400	4800	5400	4500	5300	5500	3500*	4400	5000	3900	4800	5100
	45 x 90	248	4800	5200	5700	5100	5600	5800	4300	4800	5300	4300	5200	5300
PSW4530	45 x 70	302	4900	5400	6000	5100	5900	6100	4100*	5000	5600	4400	5400	5700
	45 x 90	302	5400	5800	6400	5800	6300	6500	4700	5300	5700	4900	5800	5700
PSW4536	45 x 70	360	2600*	5800	6600	5600	6500	6800	-	5500	6000	4200	5900	6200
	45 x 90	360	5800	6300	7100	6400	6900	7200	4700	5800	6400	5600	6200	6400
PSW4540	45 x 70	412	3400*	6400	7100	6000	6900	7300	-	5800	6600	4700	6400	6700
	45 x 90	412	6200	6800	7600	6900	7400	7700	4700	6300	7000	5800	6800	7000

*Important Note: For spans in the range of 1100 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1

COMMERCIAL LOADS

SPAN CHARTS FOR BOTTOM CHORD SUPPORT FLOOR TRUSSES

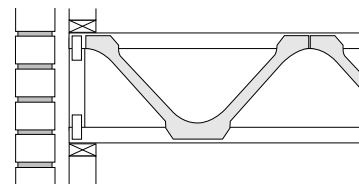

Maximum Spans for 35mm thick timber

Table 5. Maximum Spans for Commercial Floor Loads - Live Load 2.0 kPa & 1.8 kN														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW3520	35 x 70	197	1100	3800	4300	3100*	3900	4300	-	3300	3500	1100	3300	3500
	35 x 90	197	3300	4100	4300	3400	4300	4500	3000*	3500	3500	3100	3500	3500
PSW3525	35 x 70	248	1100	4500	5100	3400*	4500	5100	1100	3600	4700	3100*	3700	4800
	35 x 90	248	4000	4800	5500	4100	5100	5700	3300*	4500	4900	3500	4500	5000
PSW3530	35 x 70	302	1100	5000	5800	4100*	5100	5100	1100	4400	5200	3300*	4500	5200
	35 x 90	302	4500	5600	6200	4500	5800	6200	3700	4900	5200	3400	4800	5200

***Important Note:** For spans in the range of 1200 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1

Maximum Spans for 45mm thick timber

Table 6. Maximum Spans for Commercial Floor Loads - Live Load 2.0 kPa & 1.8 kN														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW4525	45 x 70	248	3800	4700	5400	4000	5000	5500	3300	4300	4800	3400	4400	4800
	45 x 90	248	4400	5100	5800	4500	5600	5900	3800	4700	4800	3900	4700	4800
PSW4530	45 x 70	302	4400	5600	6200	4500	5700	6500	3800	4800	5100	3900	4900	5100
	45 x 90	302	4900	5900	6500	5100	6200	6500	4300	5100	5100	4500	5100	5100
PSW4536	45 x 70	360	4900	6000	6700	5100	6300	6900	4100	5400	5700	4200	5500	5700
	45 x 90	360	5600	6400	7100	5600	7000	7200	4800	5700	5700	4900	5700	5700
PSW4540	45 x 70	412	5300	6600	7400	5500	6800	6800	4200	5600	6000	4700	6000	6200
	45 x 90	412	5700	7100	7800	6100	7400	7900	5200	6000	6000	5400	6200	6200

Table 7. Maximum Spans for Commercial Floor Loads - Live Load 3.0 kPa & 2.7 kN														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW4525	45 x 70	248	500	4100	4500	3300	4200	4500	500	3400	3500	2900*	3400	3500
	45 x 90	248	3600*	4500	4500	3700	4500	4500	3100*	3500	3500	3300	3500	3500
PSW4530	45 x 70	302	3300*	4600	4800	3800	4600	4800	500	3800	3800	3300*	3800	3800
	45 x 90	302	4100	4800	4800	4300	4800	4800	3400*	3800	3800	3600	3800	3800
PSW4536	45 x 70	360	500	5000	5400	600	5300	5400	500	3800	4300	600	4300	4300
	45 x 90	360	4000*	5400	5400	4700*	5400	5400	600	4300	4300	3900*	4300	4300
PSW4540	45 x 70	412	500	5300	5800	3900*	5600	5800	500	4000	4600	600	4600	4600
	45 x 90	412	3900*	5800	5800	5100*	5800	5800	600	4600	4600	4000*	4600	4600

***Important Note:** For spans in the range of 600 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1

Table 8. Maximum Spans for Commercial Floor Loads - Live Load 5.0 kPa & 3.6 kN														
PosiStrut® Size	Timber Size (mm x mm)	Overall Depth (mm)	450mm PosiStrut® Centres						600mm PosiStrut® Centres					
			Timber Grade											
			F5	F8	F17	MGP10	MGP12	MGP15	F5	F8	F17	MGP10	MGP12	MGP15
PSW4525	45 x 70	248	500	3000	3100	500	3100	3100	400	500	2500	500	2100	2500
	45 x 90	248	500	3100	3100	3000*	3100	3100	500	2400	2500	500	2500	2500
PSW4530	45 x 70	302	500	3000	3300	500	3300	3300	400	1800	2600	500	2600	2600
	45 x 90	302	2600*	3200	3300	2900*	3300	3300	500	2600	2600	2600*	2600	2600
PSW4536	45 x 70	360	500	600	3700	500	3300	3700	-	600	3000	500	600	3000
	45 x 90	360	600	3300	3700	600	3700	3700	500	600	3000	600	2700	3000
PSW4540	45 x 70	412	500	600	4000	500	3600	4000	-	500	3200	500	2800	3200
	45 x 90	412	500	3500	4000	600	4000	4000	500	2800	3200	500	3200	3200

***Important Note:** For spans in the range of 600 to 2600, top chords should be a minimum grade of F8 or MGP12 to conform to AS1720.1

SUPPORTING STRUCTURE

The supporting structure should be checked to ensure that beams, walls and footings are capable of supporting all loads from floors and/or roof.

As PosiStruts® allow the use of large open areas with fewer bracing walls, the stability of the structure should be checked in all cases.

1. Solid Brick Construction

Lateral stability and strength of supporting walls should be checked in accordance with Masonry Code AS3700.

2. Timber Framed Construction

The strength and bracing of timber framed walls supporting PosiStruts® should be checked using AS1684 or be designed using AS1720.1.

3. Elevated Building

For traditional elevated buildings where a central row of piers is to be removed, additional bracing may be required to provide stability to the building. This may be provided by designing ground level shear walls at each end of the building, or by using braced partition walls located centrally. If in doubt, consult MiTek Australia Ltd.


In all of the above cases the stability of the structure relies to some extent on the bracing provided by the panel flooring. For this reason it is important that floor trusses be fixed securely to supporting walls.

All cross walls and end walls should be securely fastened to the outer supporting walls. For timber framed walls use a 50 x 100 mm Strapnail at each intersection. For masonry construction, a continuous timber top plate should be installed and joined to each intersecting top plate at cross walls using 50 x 100 mm Strapnails.

HANDLING AND STORAGE


All PosiStrut® components should be strapped and stacked vertically with the bottom chord clear of the ground, supported on bearers located directly under web points. PosiStruts® may be stacked on top of each other with bearers aligned as closely as possible to web panel points.

PosiStruts® should not be left exposed to weather for extended periods of time without adequate protection. If covered, ensure adequate air circulation around the trusses.

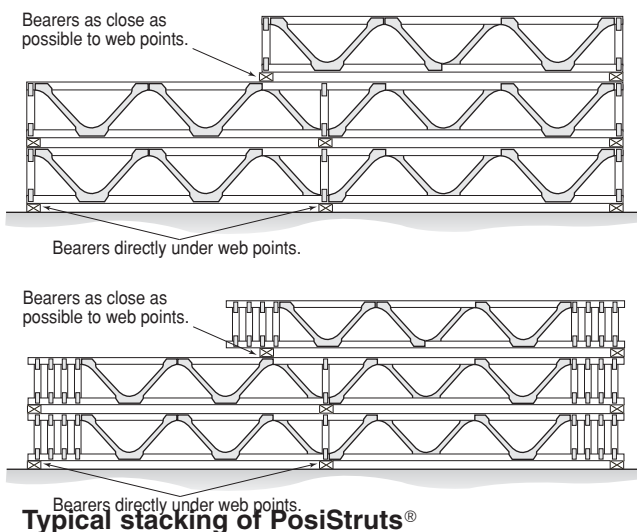

Care should be taken when handling the PosiStrut® to avoid bending, twisting or dropping. Slings should always be attached to the timber chords, and not to the metal webs to avoid buckling.

When lifting PosiStruts® with a crane, slings should be attached at panel points closest to the truss quarter points. See diagram.

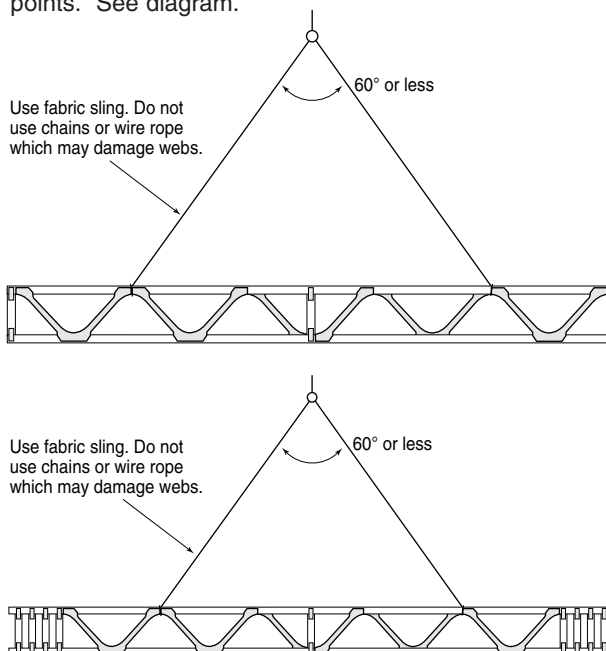

The maximum load of sheet materials temporary stored on the PosiStruts is 175kg/m² and should not be greater than 200mm deep or 1.5m high stack of prefabricated wall frames. This equates to 10 sheets of 19mm particle board, 9 sheets of 22mm particle board or 15 sheets of 13mm plasterboard. Where the sheets are stacked by hand they should span lengthways across the joists, (Fig. 1). When lifted mechanically they should be seated on 5 bearers the width of which are 600mm longer than the width of the board, (Figs. 2 & 3).

Fig. 1

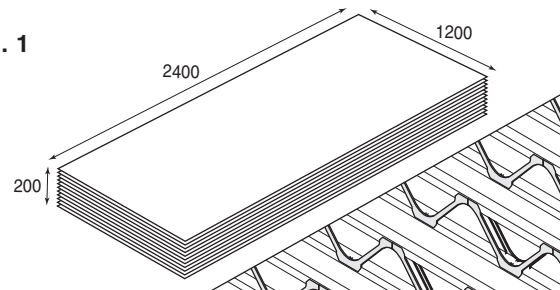


Fig. 2


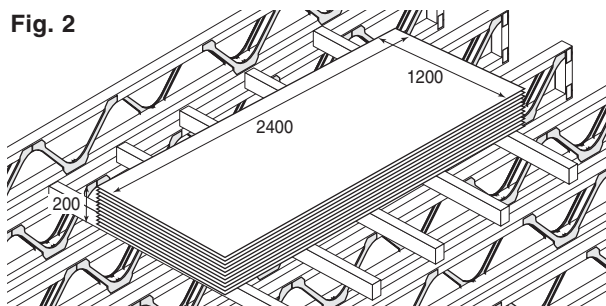



Fig. 3

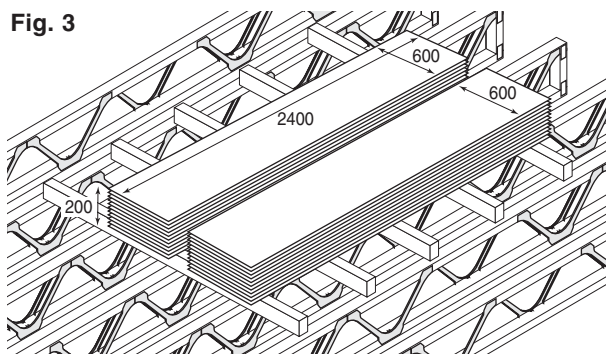

SET OUT AND PLACEMENT

PosiStruts® are generally placed perpendicular to load bearing supporting walls and should be located so that distance between them does not exceed the designed spacing.

Care should be taken to place the PosiStruts® the right way up. Unless marked otherwise PosiStruts® are always manufactured so that Posi-Web starts at the top chord at each support point. There are occasions where it is necessary to design and manufacture PosiStruts® with the first web starting at bottom chord level. In this case trusses will be marked "THIS WAY UP".

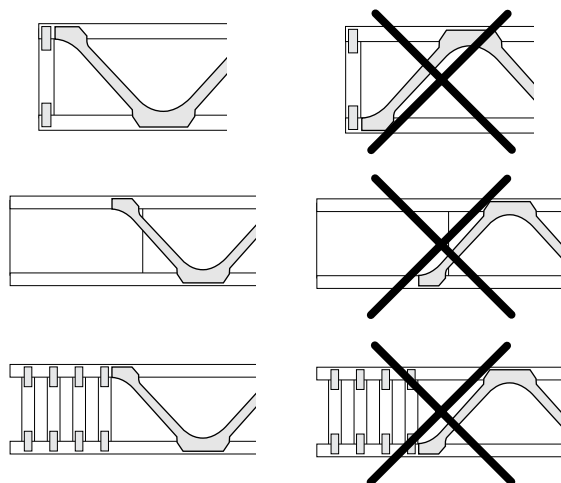


Right way up

Wrong way up

PosiStruts® must be installed plumb and straight. Support location tolerance is 50mm with no reduced bearing. Check bearing strength where bearing area is reduced.

For top chord support, the gap between bearing and timber web must not exceed 6mm.

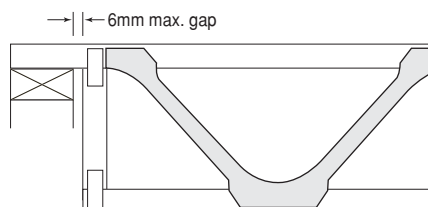

TRIMMING ON SITE

Only PosiPlus® and PosiJoist® members can be trimmed to length on site. PosiTrusses are required to be manufactured to the required span for each project. Under no circumstances should PosiTrusses be cut or modified in any way without prior approval from the truss fabricator.

Trimming limitations for PosiJoist®

PosiJoists® within the limits specified below may be trimmed each end by up to 335 mm for PJ20, PJ25 and PJ30 and up to 430mm for PJ36 and PJ40. **PosiJoists® should only be cut at locations between vertical webs.** The following procedure will allow trimming of PosiJoists® to match your exact span.


- Where a supporting wall is to provide support to two abutting PosiJoists®, position PosiJoists® first so that there is equal bearing for each PosiJoist®. Also ensure that there is a vertical member located over the supporting wall.
- Check opposite support to ensure that a vertical timber web is also located over the support (allowable misplacement 5mm). Adjust location of truss until it is possible to trim without cutting through verticals.

- Use the first PosiJoist® as template for remaining trusses.

Note: Do not cut through vertical webs. It should only be necessary to cut at a position between vertical members.

Trimming limitations for PosiPlus®

PosiPlus® members may be trimmed at either end to within a minimum distance of 90mm from the PosiStrut® web.

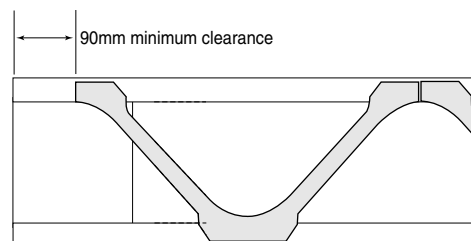

SUPPORTING EXTERNAL WALLS


CASE 1. Upper Storey of 2 Storey - for the upper storey of two storey construction, where the lower stud wall provides continuous support, and where wall plates and lintels have been sized in accordance with AS1684 lower storey load bearing walls, standard PosiStruts® may be used to support upper walls where the effective length of roof supported does not exceed that given in Table 9. below.

Table 9. Maximum Effective Length of Roof (EL) Supported by Standard PosiStrut® Trusses		
PosiStrut® or PosiJoist® Size	Sheet Roof (mm)	Tile Roof (mm)
PSW3520	5,050	3,950
PSW3525	5,550	4,350
PSW3530	6,750	5,300
PSW4525	8,150	6,100
PSW4530	9,000	6,750
PSW4536	7,450	5,600
PSW4540	7,450	5,600

Note: The above table has been determined for sheet roof at 900mm centres and tiled roof at 600mm centres with maximum 25° roof pitch, floor live load 1.5kPa.

Where effective length of roof supported is greater than those in Table 9, F-Frame as specified below, solid bearer or standard PosiStrut® with timber verticals inserted under studs may be used.


F-Frame manufacturing details

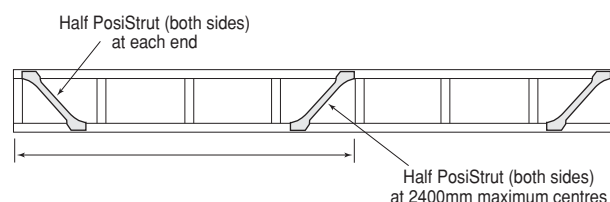

The sizes and grades of top and bottom chord of the F-Frame can be determined as per wall plates from AS1684 by adopting the vertical strut as stud spacing. Vertical struts do not necessarily have to line up with common studs if the wall plates have been designed accordingly.


Where there are larger openings in the upper storey wall which cause a concentrated load on the PosiStrut® or F-Frame, a suitable timber vertical member should be inserted between the top and bottom chord under the point load to transfer it down to the wall below.

- Note:** 1. PosiStrut® chords and F-Frame chords may be considered to act in conjunction with wall plates to form a double plate or ribbon plate.
2. Where openings are positioned in end walls, lintels are to be sized in accordance with AS1684.

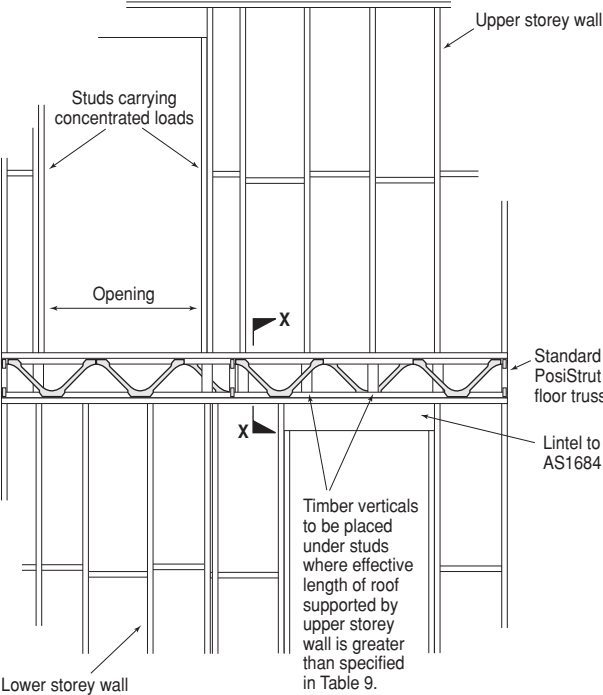

End wall - Upper Storey

SECTION X-X

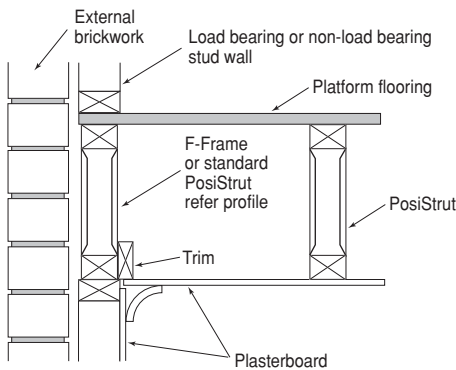


WARNING

Where stair wells or other voids are located adjacent external walls, the stability of the external wall should be checked by a structural engineer.

Generally, F-frames may be used to support upper walls of two storey construction at end walls where floor and ceiling acts as a diaphragm to restrain the external wall against lateral loads.


However, F-frames should not be used whenever supporting external walls that have an opening for a void area or staircase as shown. In these cases, the external walls are required to be designed by a structural engineer.

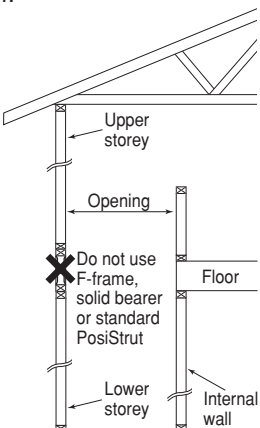

CASE 2. Single Storey - for a single storey construction where continuous support for the end F-Frame is not available, frames using PosiJoist® End detail may be used provided the roof load (EL) does not exceed that specified in Table 10, and that pier spacing does not exceed 1200 centres.

PosiJoist® End Size	Sheet Roof (mm)	Tiled Roof (mm)
PJE25	7200	3600
PJE30	7200	3600
PJE36	7200	3600
PJE40	7200	3600


Where the effective length of roof supported exceeds that specified in Table 10, use either solid timber or laminated ConstructaBeams to support end wall and roof loads. Bearer sizes to be taken from AS1684, relevant State Timber Framing Code or refer Gang-Nail Span Charts for laminated ConstructaBeams or AutoBeam.

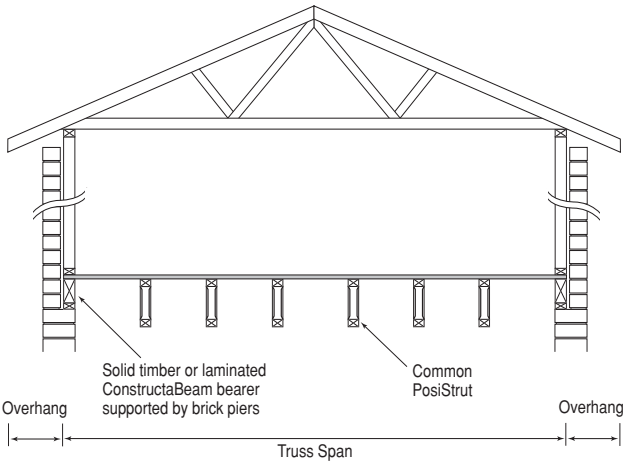


End wall - Single Storey

$$EL = 2 \times \text{Overhang} + \text{Truss Span}$$


PosiJoist END 25 (PJE25)

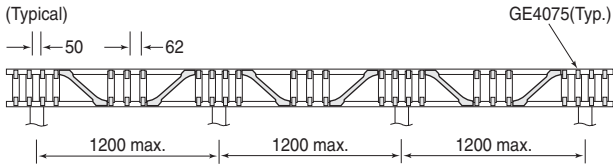


PosiJoist END 30 (PJE30)

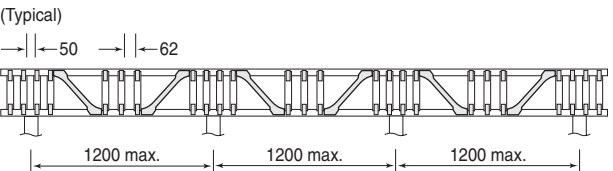

PosiJoist END 40 (PJE40)

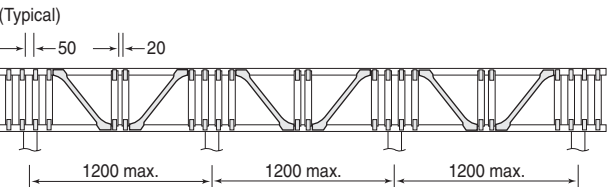


CASE 3. Building with Hip Ends - Both of the above two cases apply, provided the truncated girder truss station does not exceed the effective length of roof supported specified in Table 9.

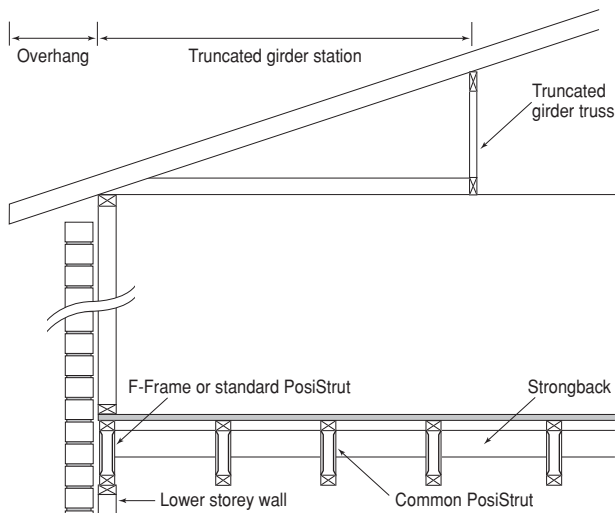

End wall - Building with Hip End Upper Storey of 2 storey

EL = Truncated Girder Truss Station + 2 x Overhang

CASE 4. End Walls for Single Storey Buildings with Hip Roof - As for case 2 except EL = Truncated Girder Station.

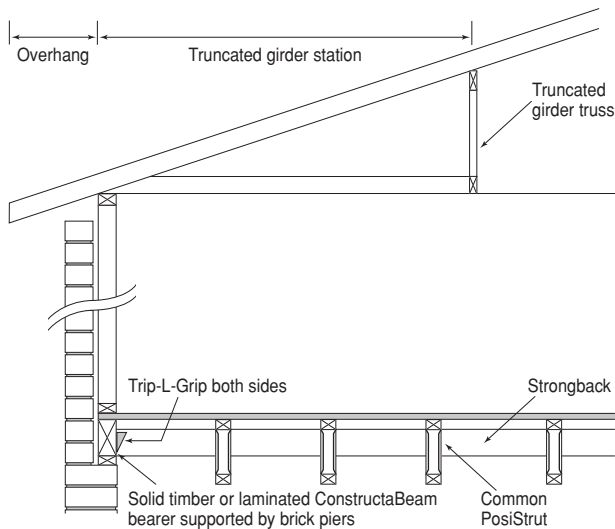

End wall - Building with Hip End Single Storey

EL = Truncated Girder Truss Station + 2 x Overhang

CASE 5. End Walls for Buildings with Gable Roof - Similar to that of building with Hip End, except the effective length of roof supported is as follows:


EL = 2 x Verge Overhang + Truss Spacing

SUPPORTING NON-LOAD BEARING WALLS


Non-load bearing walls require no additional support. However, for braced walls with bracing capacity of up to 3.0 kN/m and 2700mm high, additional fixing is required as detailed below. For braced walls with bracing capacity and height exceeding this limit, specific design is required.

Walls Perpendicular to PosiStruts®

Fix each end of bracing wall using 2/90 x 35 F5 under battens with M10 bolt and washer.

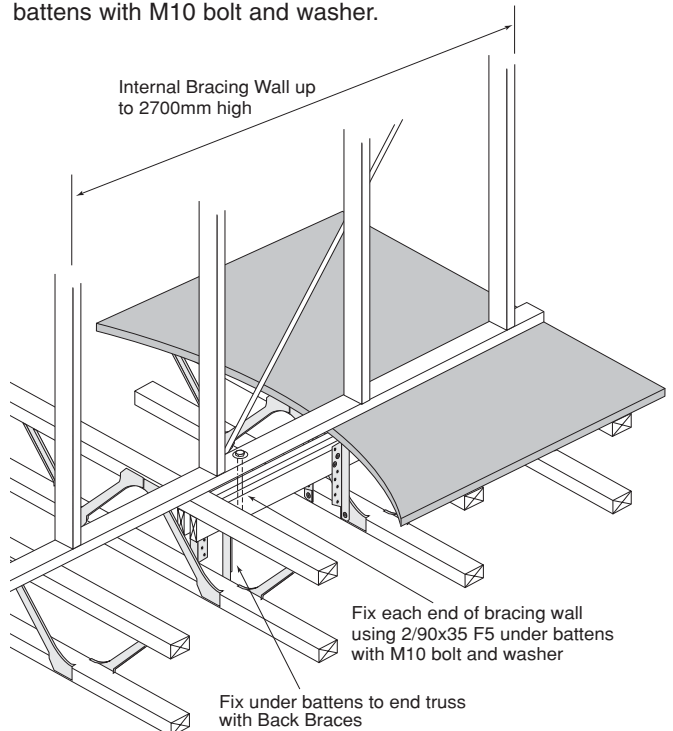

Braced walls perpendicular to trusses with bracing capacity up to 3.0 kN/m

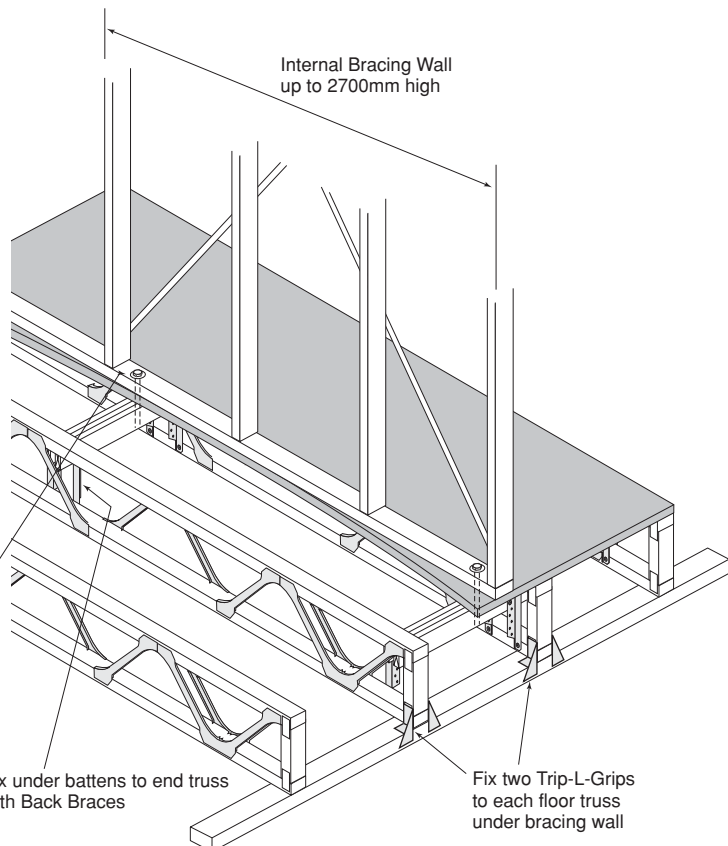


Bracing walls parallel to trusses with bracing capacity up to 3.0 kN/m

Walls Parallel to PosiStruts®

a) Platform Flooring


Where a platform floor is to be used, ensure the flooring material is capable of supporting walls. Fix each end of bracing wall using 2/90 x 35 F5 under battens with M10 bolt and washer.

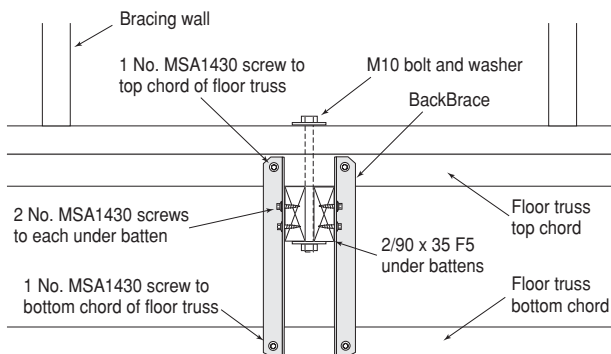

Under batten fixing detail

b) Fitted Flooring

Where flooring is fitted to each room after internal walls have been constructed, an additional truss is required below the wall to provide support to both the wall and flooring.

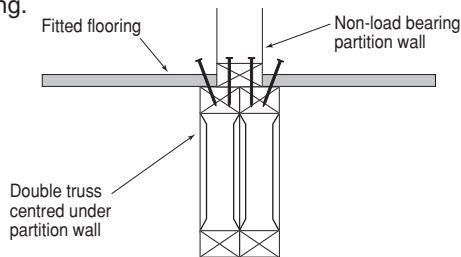



Fitted Flooring

Double trusses used under non-load bearing internal partition walls should be located such that the partition is bearing equally on both trusses. Flooring and strongbacks should be fixed to both trusses.

SUPPORT DETAILS

PosiStrut® Bottom Chord Support

PosiStruts® may be supported on their bottom chord as shown

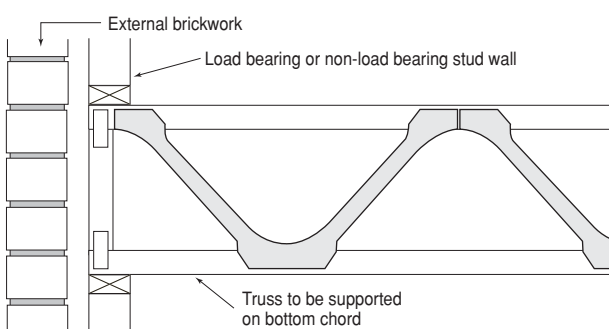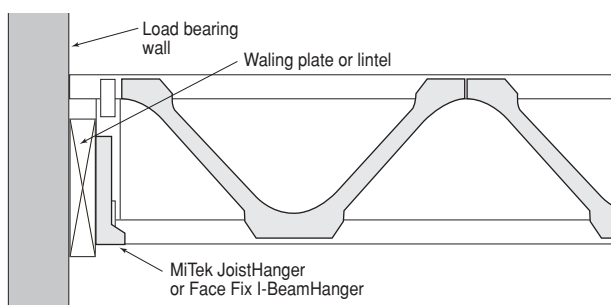

PosiStrut® Top Chord Support

The maximum span of top chord supported PosiStruts® may be increased to the maximum span of the bottom chord trusses, if the end vertical web is fastened to the supporting beam with Gang-Nail Trip-L-Grips or if one of the following details are used:

1. Double end vertical web - see Figure 'X'.
2. Timber End Block - see Figure 'Y'.

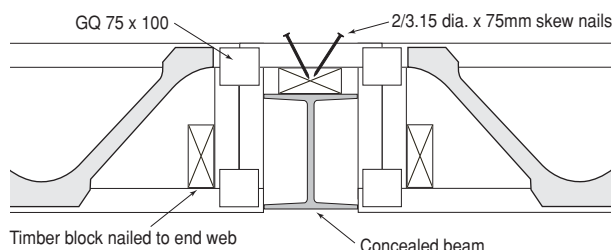
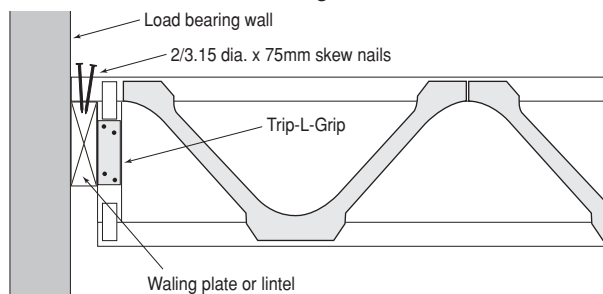


Figure 'X'

Recommended Timber Blocking Sizes

PosiStrut Depth	200	250	300	360	400
Strongback Size	90 x 35	120 x 35	140 x 35	170 x 35	190 x 35

Timber End Block for Top Chord Supported PosiStruts®




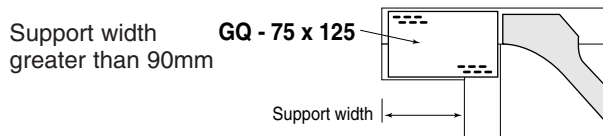



Figure 'Y'.

PosiStrut® Top Chord Support onto steel beam

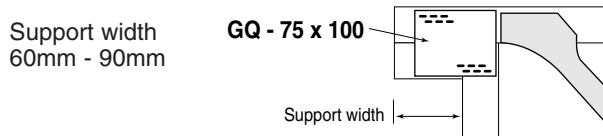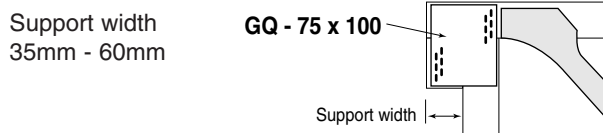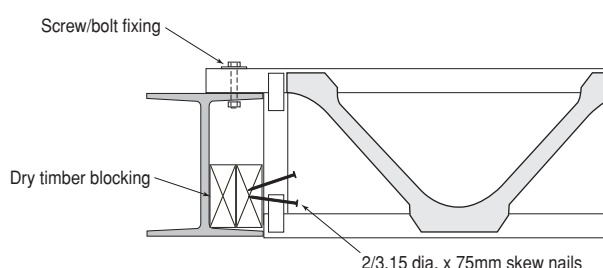


PosiJoist® Bottom Chord Support

PosiJoists® should only be supported on their bottom chord as shown.

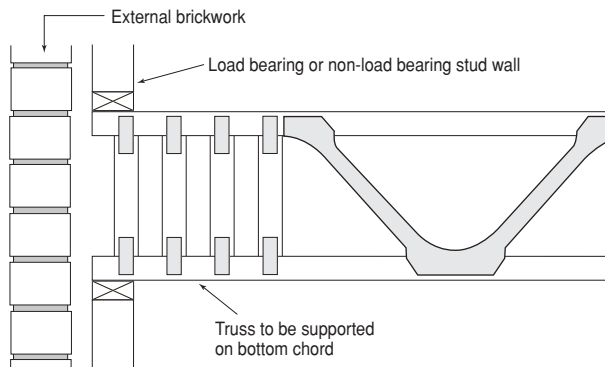


PosiPlus® Bottom Chord Support

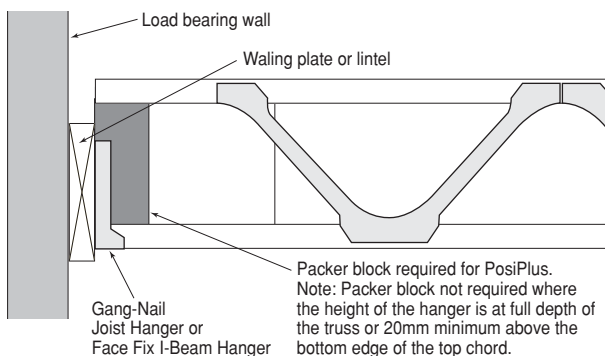

PosiJoist® Top Chord Support

Where it is necessary to support PosiJoists® by the top chord as shown, Trip-L-Grip's are required to fasten the truss end vertical web to face of the supporting beam

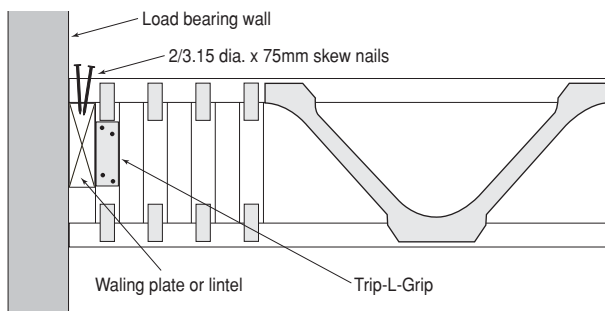

Hangers for Floor Trusses


Floor trusses may be supported by Joist Hangers or I-Beam Hangers in accordance with MiTek 20/20 fixing schedule.

FIXING AND CONNECTIONS


Fixing to External Walls

Each PosiTruss® to be fixed onto the supporting structure by a minimum of 2/3.15mm diameter x 75mm long nails. For wind classification areas higher than N2 refer to AS1684 for details.

PosiStrut®

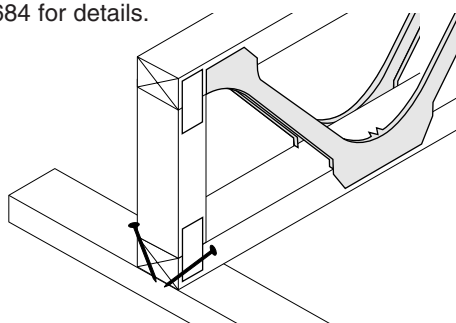


PosiJoist®

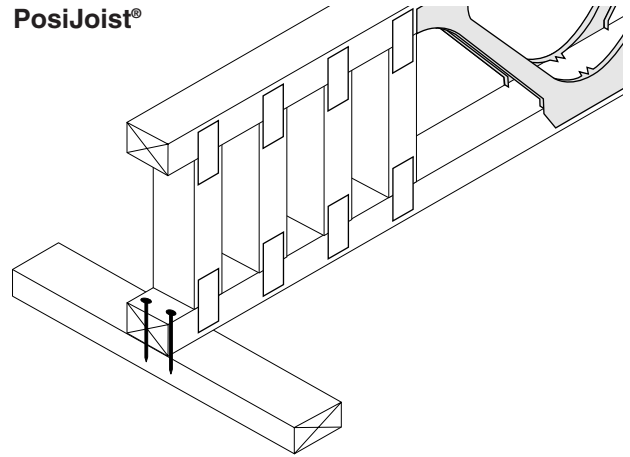


Fixing to Internal Walls

When PosiStruts® are to be supported by internal walls place PosiStruts® side by side and fix as above or butt together using a 50 x 100mm Strapnail to connect PosiStruts®.

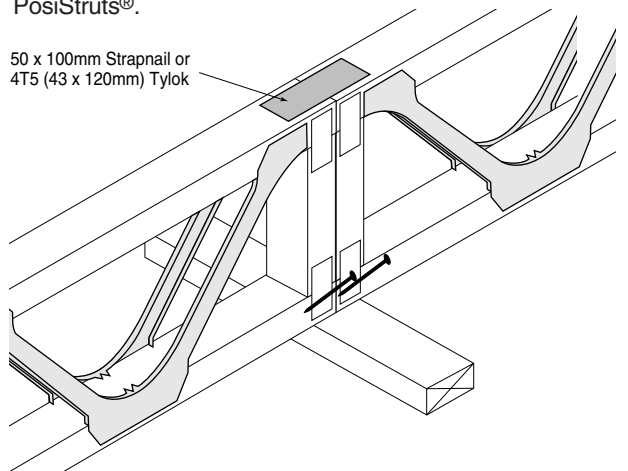

Support of Internal Load Bearing Walls

PosiStruts® are generally not designed to support load bearing internal walls, however where there is a supporting wall directly below, PosiJoist® and PosiPlus® trusses should be strengthened as illustrated below.

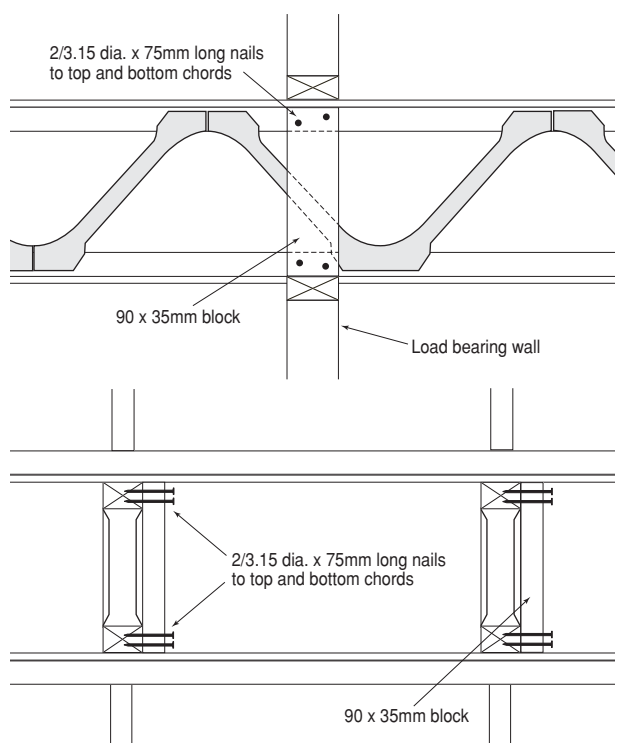


Fixing to Internal Walls


a) Non-bracing wall

If internal walls are not designed as bracing walls, fix the truss with the InternalWall Bracket with nails at the top of the slots to allow for truss settlement as it is loaded. Brackets are fixed at 1.8m centres along unsupported sections of the wall. Where trusses are parallel to walls, trim between the bottom chords and fix brackets to the trimmer. Where internal walls are stable in their own right, no InternalWall Brackets are required.

Truss Parallel to Non-Bracing Wall

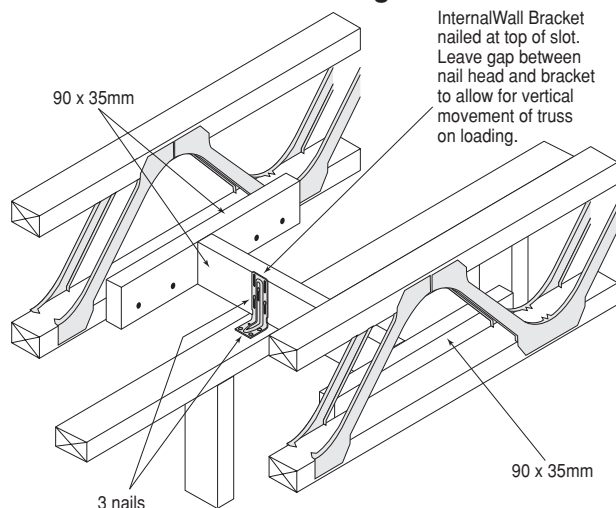


Truss Perpendicular to Non-Bracing Wall

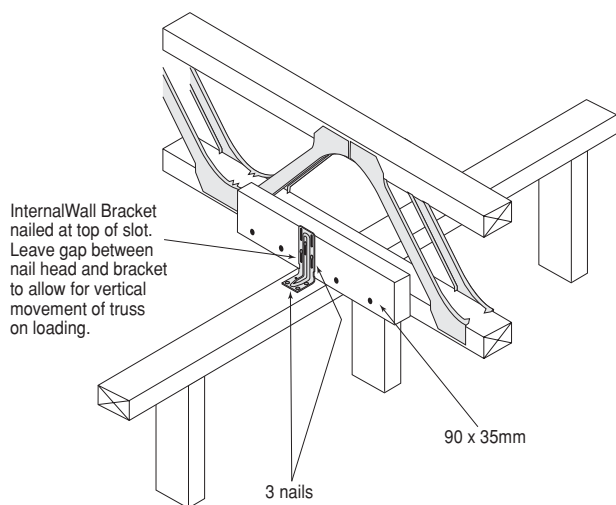

b) Bracing Wall

Where internal walls are designed as bracing walls, trusses should be fixed to the top plate using structural connections of equivalent strength to the bracing strength of that particular bracing wall. The connection should also allow the truss to deflect vertically when it is loaded.

Truss Parallel to Bracing Wall

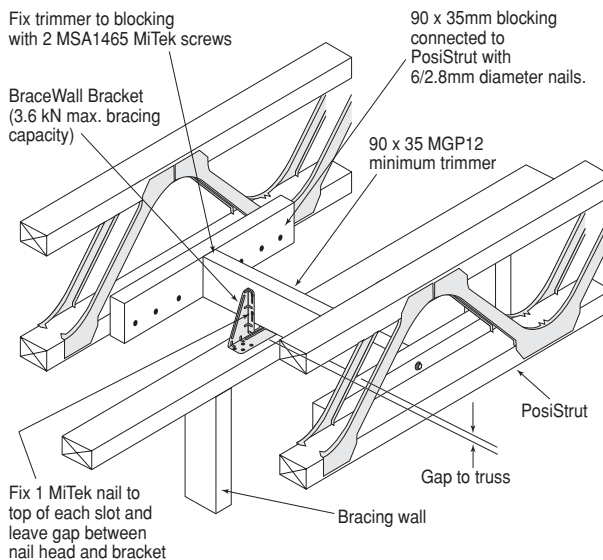

Truss Perpendicular to Bracing Wall

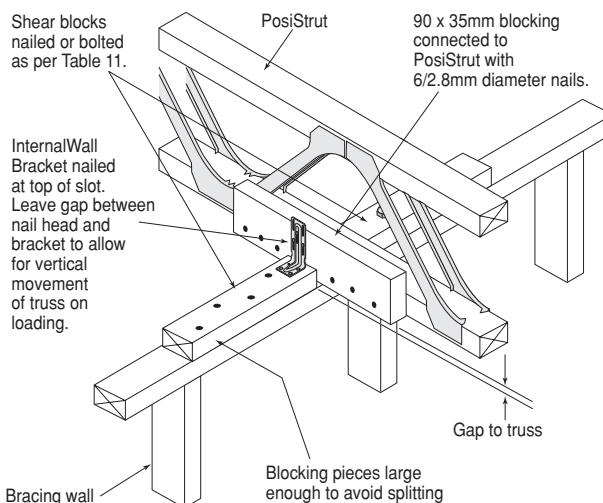


Table 11 - Fixing details for Bracing Walls

Type of Connection	Number of Type A or Type B bracing units in braced wall (Refer AS1684 Part 4)											
	Unseasoned Timber						Seasoned Timber					
	J2		J3		J4		JD4		JD5		JD6	
	Type A	Type B	Type A	Type B	Type A	Type B	Type A	Type B	Type A	Type B	Type A	Type B
Nails												
4/3.05ø	1.6	N	1.1	N	N	N	1.1	N	N	N	N	N
6/3.05ø	2.1	1.1	1.5	N	1.1	N	1.6	N	1.2	N	1.0	N
4/3.33ø	1.9	N	1.3	N	N	N	1.3	N	1.1	N	N	N
6/3.33ø	2.4	1.2	1.7	N	1.2	N	1.8	N	1.5	N	1.1	N
Bolt Size												
M10	2.5	1.3	2.2	1.1	1.7	N	2.0	1.0	1.6	N	1.3	N
M12	3.3	1.6	2.6	1.3	2.1	1.0	2.4	1.2	1.9	1.0	1.5	N
Screws												
2 No.14 Type 17	3.2	1.6	2.3	1.2	1.6	N	2.3	1.2	1.6	N	1.2	N
3 No.14 Type 17	5	2.5	3.3	1.7	2.5	1.2	3.3	1.7	2.5	1.2	1.8	N


N - Not Suitable

Fixing to Steel Beam


Note:

1. Size of packers and timber fixing plate to suit steel flange width.
2. Timber fixing plate is to be contained within the steel beam flange so as to restrain any vertical load induced by PosiStrut® trusses.

PosiTruss®

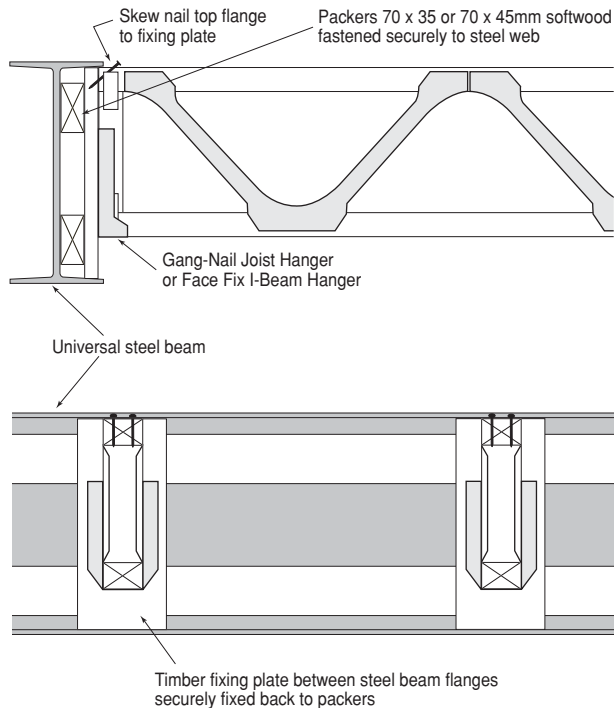

PosiPlus®

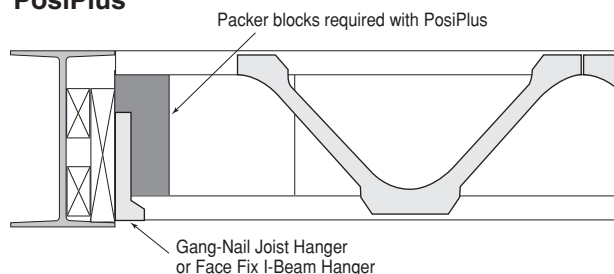

Notched PosiPlus® to Steel Beam


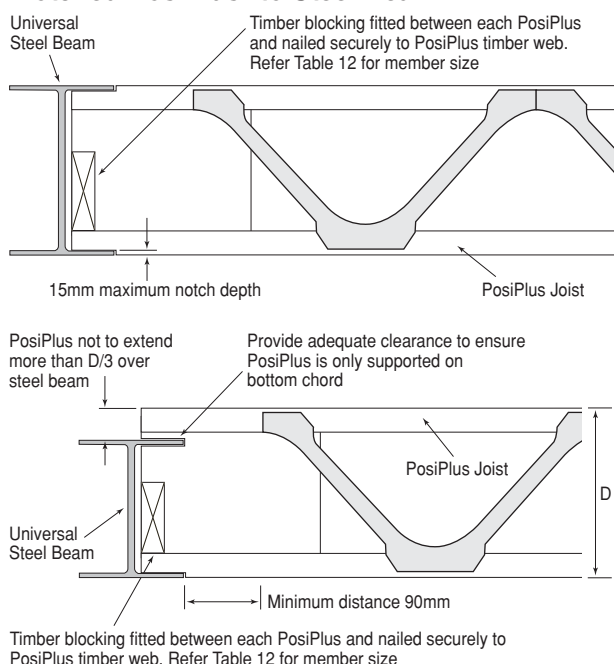


Table 12. Timber Blocking Size Required	
PosiPlus®	Timber Blocking Size
PP 250 deep	120 x 35
PP 300 deep	140 x 35

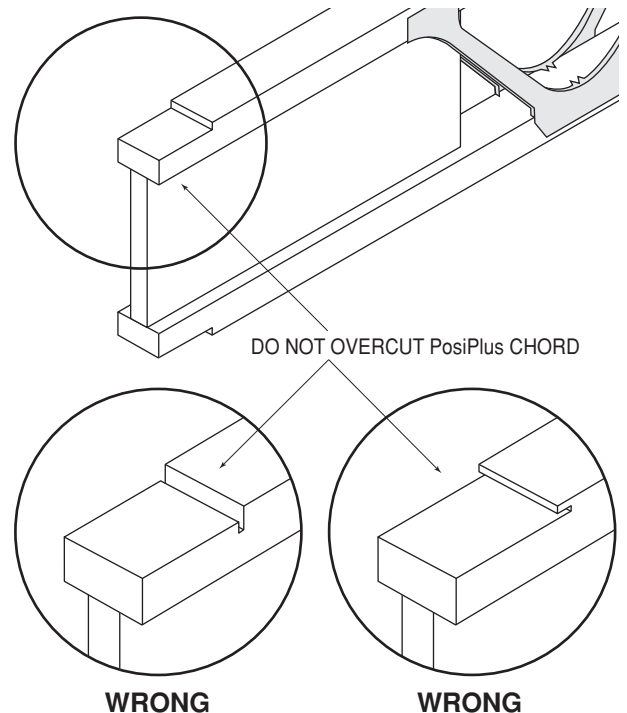


STRONGBACKS

Strongbacks are bracing members running at right angles to PosiStruts®. Strongbacks significantly dampen vibrations and increase the stiffness of the floor system. The performance of the floor depends very much on the proper installation of strongbacks. They should be placed at 2400mm maximum spacing along span of each truss as close as possible to midspan.

Strongbacks are to be supported off end walls and preferably at any internal walls to increase floor stiffness. They should be strutted off walls with a short jack stud or prop skew nailed into place.

Strongbacks must be fixed to central vertical webs on each PosiStrut® with 3/2.15mm diameter nails and spliced in accordance with details following.

Strongback supported off wall

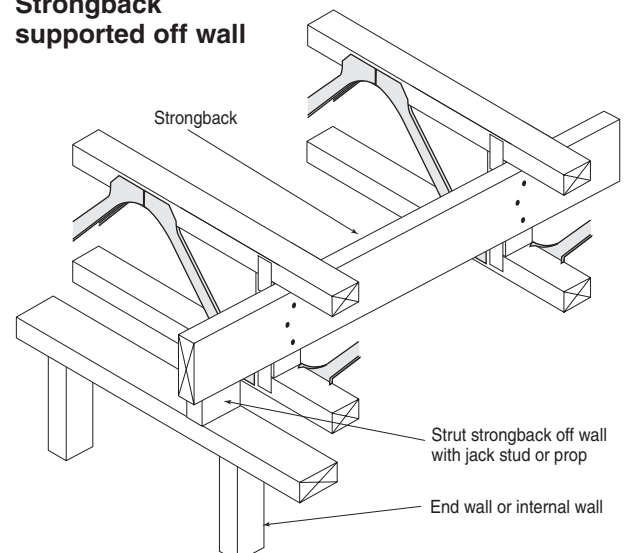


Note:

1. Timber grades for strongback sizes given in the above table to be equivalent to or higher than grade used for PosiStrut® chord sizes.
2. Alternatively a deeper section strongback of a lower grade may be used. Reduce by one grade for each 25mm increase in depth.
3. It is recommended strongbacks be used to align trusses during installation by locating the strongback hard against the underside of truss top chord or top of bottom chord before fixing to timber web or Back Brace.


Table 13. Recommended Strongback Sizes

PosiStrut Depth	200	250	300	360	400
Strongback Size	90 x 35	120 x 35	140 x 35	170 x 35	190 x 35

Strongback fixing and splice

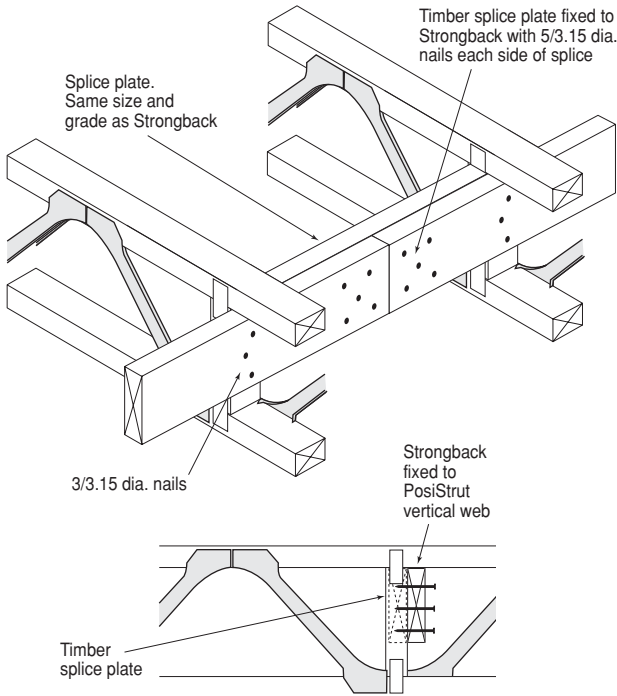

Strongback to double truss connection

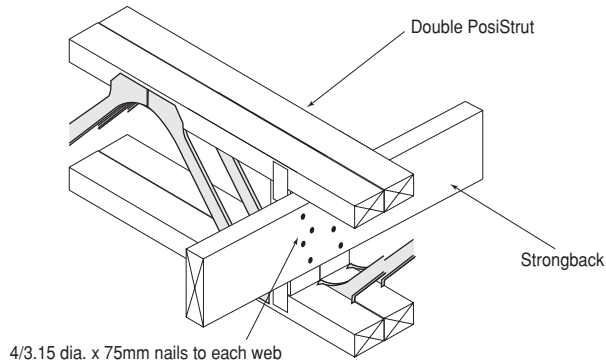

Alternative strongback splice


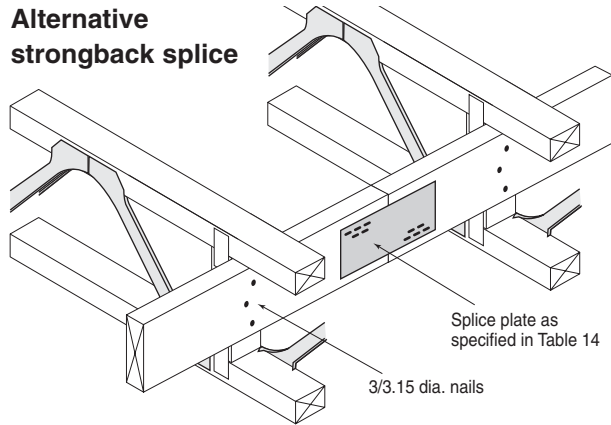


Table 14. Splice Plate Sizes

Strongback Size	Joint Type	GN Plate Type & Size	Tylok Plate Type & Size
90 x 35	Single	GE75150	TL6T10
120 x 35	Single	GE75150	TL6T10
140 x 35	Double	GQ50150	TL6T5
170 x 35	Double	GQ63150	TL6T7
190 x 35	Double	GQ63150	TL8T7


When strongback location changes, the strongback must run through to the next PosiStrut® and be connected to the side as per detail following.

Connection of strongback to PosiStrut® at change of span

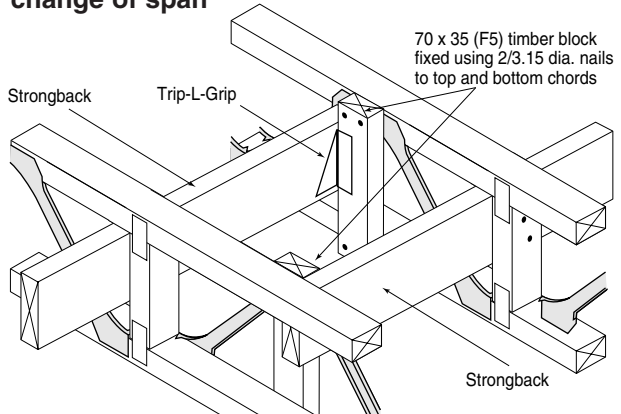

Strongback fixing using Gang-Nail Back Brace bracket

The Back Brace allows the strongback to be fixed at positions other than at timber vertical webs. This enables the strongback to be fixed in a continuous line when there are variations in span.

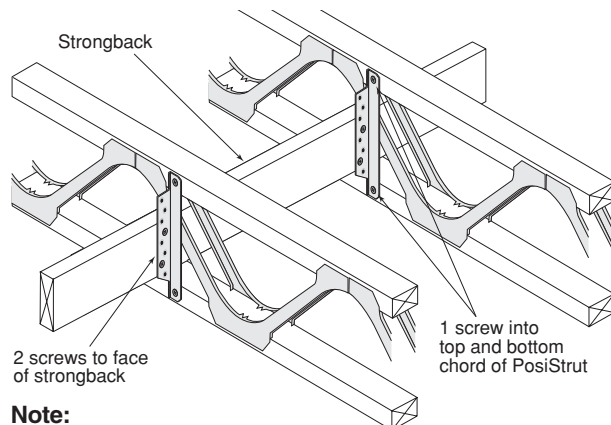

Note:

1. All screws MiTek 14 gauge x 30mm.
2. Do not over tighten screws.

STAIR OPENINGS

Where openings are required on the upper floor for stairwells, one or more shorter PosiStruts® may be used and supported on headers fixed to adjacent PosiStruts®.

The header beam maybe supported on double PosiStruts® as shown below. For header beam sizes refer Table 15. The connection of the header to the double PosiStrut® is as shown on page 16.

Note that header beams have been designed to carry PosiStrut® floor loads only.

Note:

PosiJoist to be supported by fixing end vertical web as specified on page 11.

PosiPlus® Header Beam Fixing Detail

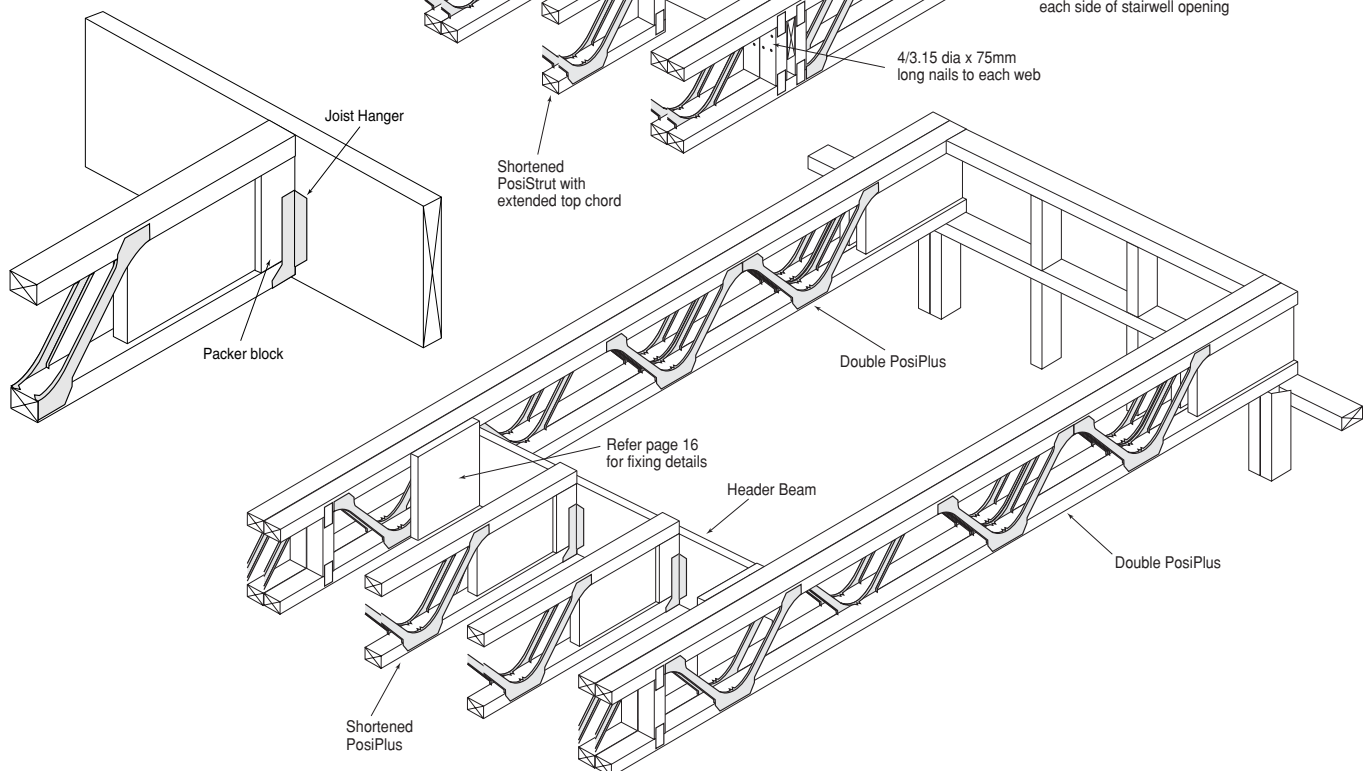


Table 15. Header Beam Sizes to Support PosiStrut® Only - 1.5kPa Floor Live Load

Shortened Truss Span	Header Beam Span (mm)						
	900	1200	1500	1800	2100	2400	2700
2000	90 x 45 MGP10	90 x 45 MGP10	90 x 45 F17	120 x 45 MGP12	140 x 45 MGP12	190 x 35 MGP12	190 x 35 MGP12
3000	90 x 45 MGP10	90 x 45 MGP12	120 x 35 MGP12	140 x 35 F17	140 x 45 F17	190 x 45 MGP12	190 x 35 F17
4000	90 x 45 MGP12	90 x 45 F17	120 x 45 MGP12	140 x 45 F17	190 x 45 F17	190 x 45 F17	190 x 45 F17
5000	90 x 45 MGP12	90 x 45 F17	120 x 45 F17	140 x 45 F17	190 x 45 F17	190 x 45 F17	240 x 35 F17
6000	120 x 45 MGP12	120 x 35 F17	120 x 45 F17	190 x 35 F17	190 x 45 F17	240 x 45 F17	240 x 45 F17

Illustrated below are some common types of stairwells (refer to Figures 1 to 3). For each diagram there are certain conditions that need to be observed.

For other types of stairwells, and for dimensions greater than those shown in Figures 1 to 3, contact your PosiStrut® supplier.

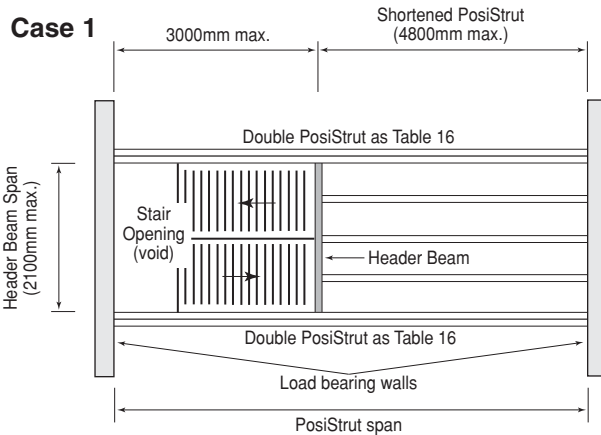


Figure 1

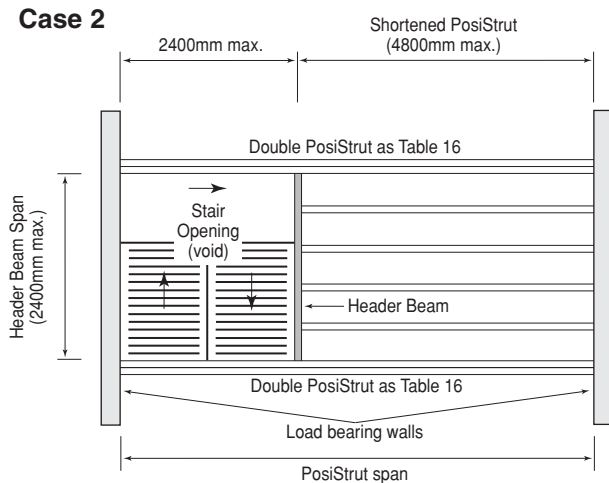


Figure 2

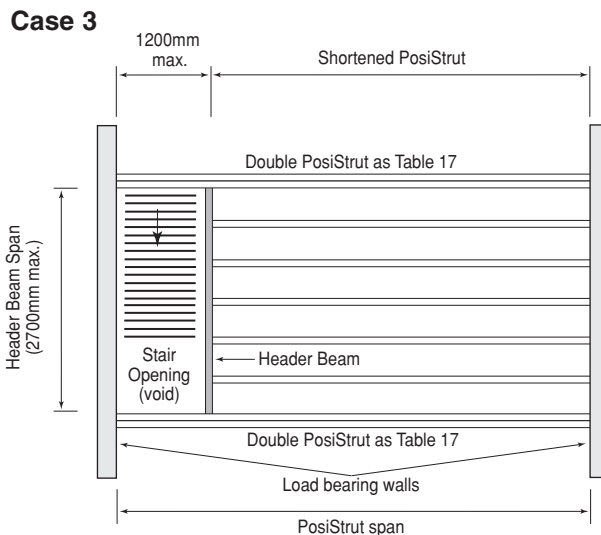


Figure 3

Note:

1. These double PosiStruts® have been designed to carry header beams which support shorter PosiStruts® only. They will not carry the stairwell itself.
2. Double PosiStruts® have also been designed for 600mm maximum truss centres. Therefore, web layouts of 600mm truss centres should be used.

Table 16. Maximum Spans for double PosiStrut® Case 1 and Case 2 Supporting Header Beam - 1.5kPa Floor Live Load


PosiStrut® Size	Timber Size (mm x mm)	Timber Grade			
		MGP10	MGP12	MGP15	F17
PSW3520	35 x 70	3200	3700	3700	4200
	35 x 90	3400	3900	3900	4400
PSW3525	35 x 70	3400	4100	4100	4800
	35 x 90	3800	4500	4500	5100
PSW3530	35 x 70	3600	4400	4400	5400
	35 x 90	3900	5000	5000	5700
PSW4525	45 x 70	3700	4500	4500	5000
	45 x 90	3900	4800	4800	5300
PSW4530	45 x 70	4000	4900	4900	5600
	45 x 90	4400	5600	5600	6000
PSW4536	45 x 70	4500	5400	5400	5700
	45 x 90	5000	6000	6000	6500
PSW4540	45 x 70	4500	5500	5500	6600
	45 x 90	5200	6100	6100	6700

Table 17. Maximum Spans for double PosiStrut® Case 3 Supporting Header Beam - 1.5kPa Floor Live Load

PosiStrut® Size	Timber Size (mm x mm)	Timber Grade			
		MGP10	MGP12	MGP15	F17
PSW3520	35 x 70	2300	3100	3600	3600
	35 x 90	2900	3500	3600	3600
PSW3525	35 x 70	2900	3600	3700	4000
	35 x 90	3100	3600	4200	4500
PSW3530	35 x 70	3100	4000	4000	4400
	35 x 90	3600	4000	4500	4700
PSW4525	45 x 70	3200	4000	4600	4600
	45 x 90	3600	4600	4600	4600
PSW4530	45 x 70	3600	4200	4900	4900
	45 x 90	4000	4500	4900	4900
PSW4536	45 x 70	3800	4700	4700	4700
	45 x 90	4700	4700	4700	4700
PSW4540	45 x 70	4700	5000	5000	5000
	45 x 90	5000	5000	5000	5000

Header Beam Connection

Where double PosiStruts® are supporting header beams, strongbacks are to be fixed to each truss using 4/3.15mm diameter x 75mm long nails.

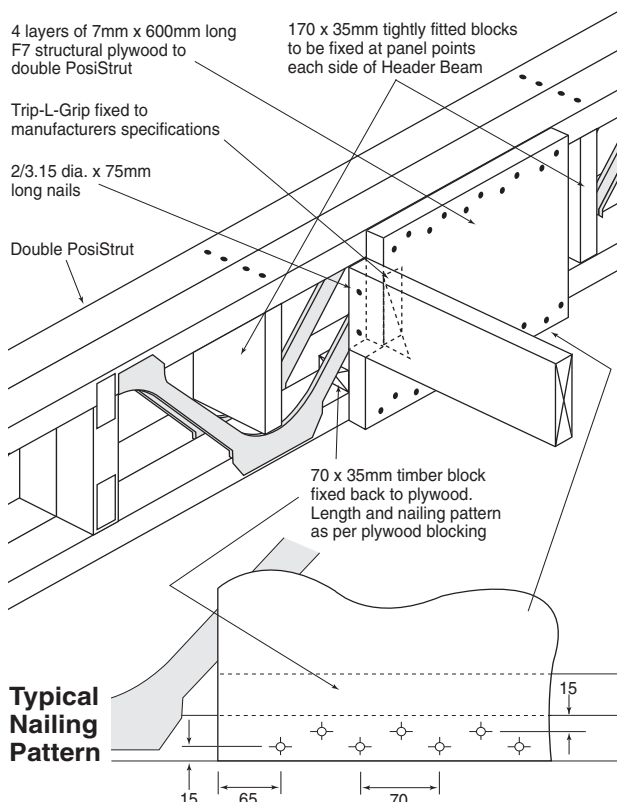

CANTILEVERS


Non Load Bearing Wall

Cantilevered balconies can be formed using solid timber either fitted into trusses between chords or off to the side of the truss as shown below. The cantilever beam can be sized from timber span charts and should extend back into the building to a distance greater than the balcony length. Balcony cantilevers should be no greater than one fifth of the floor truss span.


For cantilever beams built into PosiStrut® trusses ensure full bearing along top and bottom chord using suitable dry timber packers fixed to both truss and beam with 3.15mm dia. nails at 225mm centres.

For beams supplied separate to trusses, fix to vertical webs with a minimum of 3/3.15mm dia. nails and to the first strongback with 1 Trip-L-Grip. Provide lateral ties to top edge of beam at 600mm centres fixed to beam with 1/3.15mm dia. nail.

Built in cantilever beam.

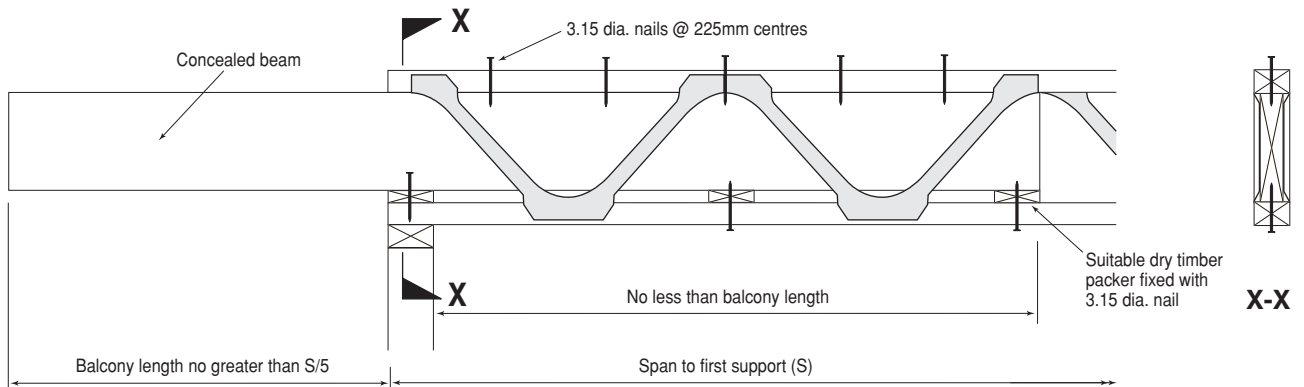


Lapped and nailed cantilever beam.

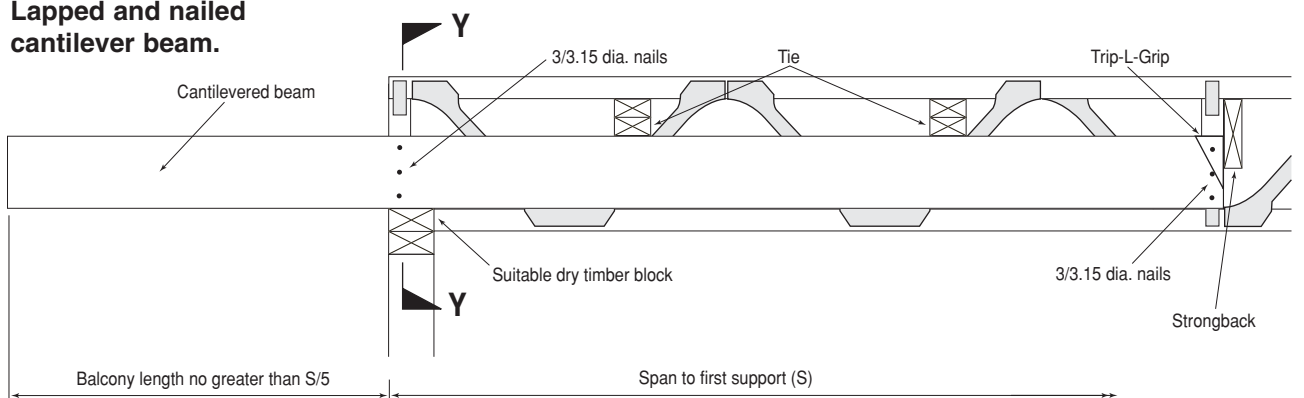



Note:

1. Cantilever beam has been designed to carry balcony load only. Size and grade can be obtained from AS1684.
2. If cantilever is exposed to weather, place damp proof course between joist and PosiTruss®.

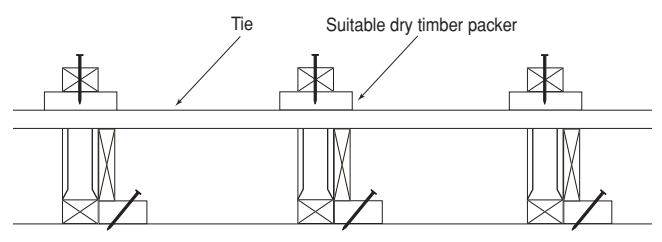

SECTION Y-Y


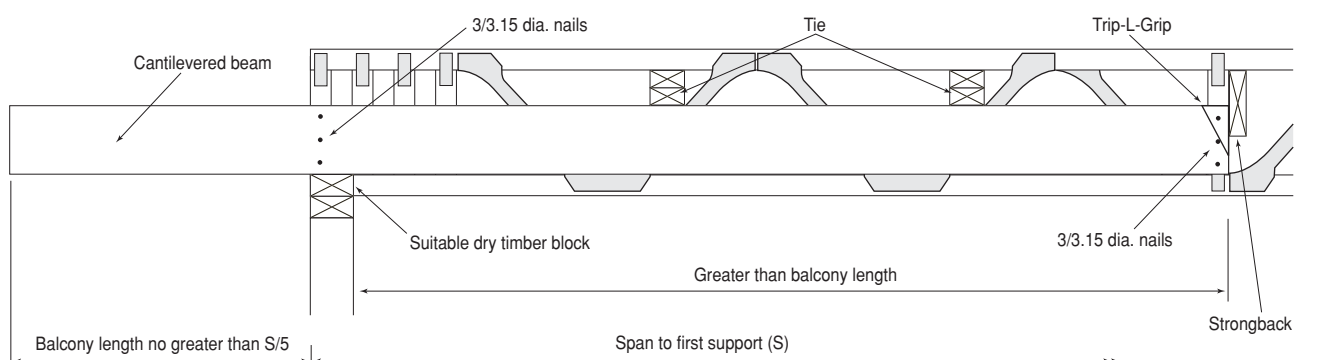


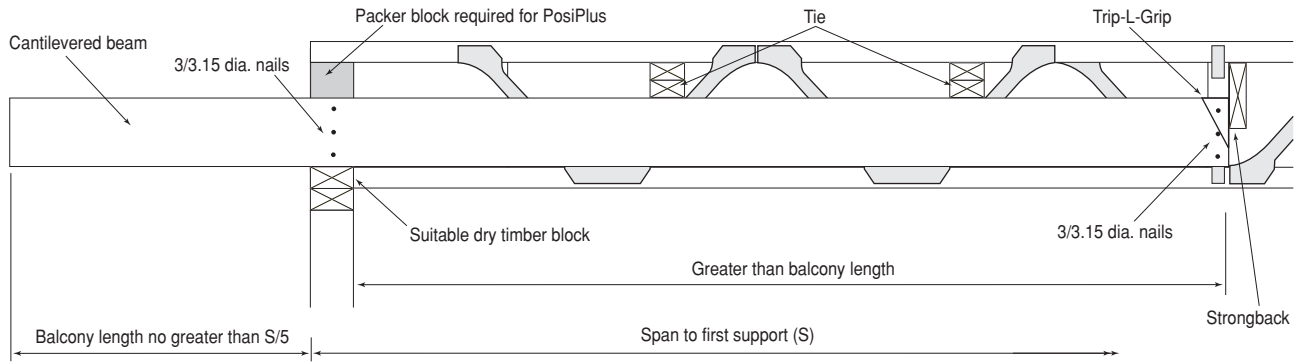

Load Bearing Wall

PosiPlus®

Standard PosiPlus® trusses may support an external load bearing wall on a cantilever provided that the cantilever does not exceed 160mm and maximum standard roof truss span does not exceed 12m for both sheet and tile roof. Wall cladding of 30kg/m² maximum is also allowed for.

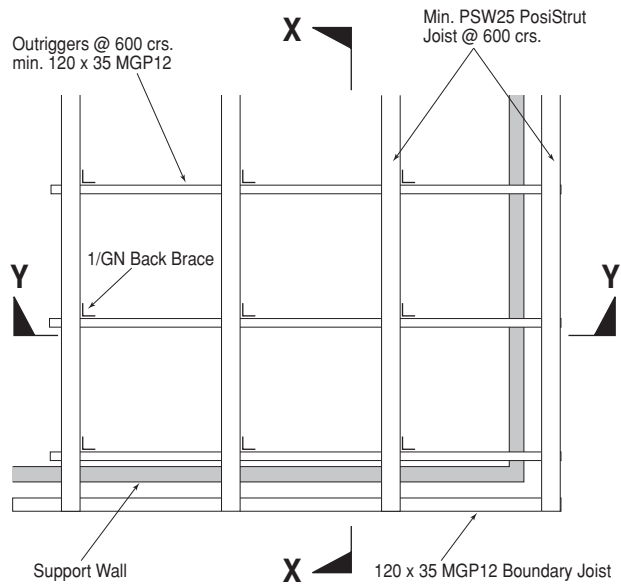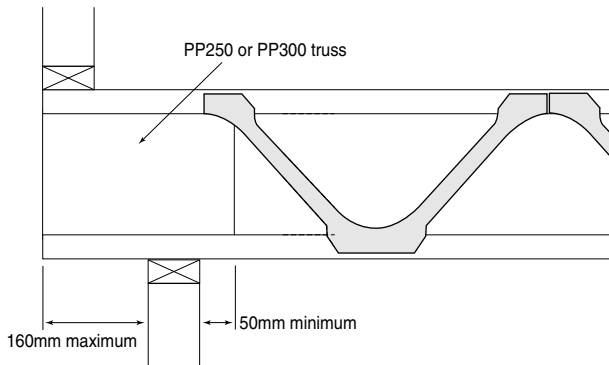

PosiTruss®


PosiStrut standard outrigger system is recommended for PosiTruss with small cantilevers with the following limitations.

Endwall supporting max 9m span trusses for:


- Tiled roof @ 600 crs.
- Sheet roof @ 900 crs.
- Not for girder loads
- Max. wall height of 2400mm

For girder loads contact MiTek state engineering office.

SECTION Y-Y

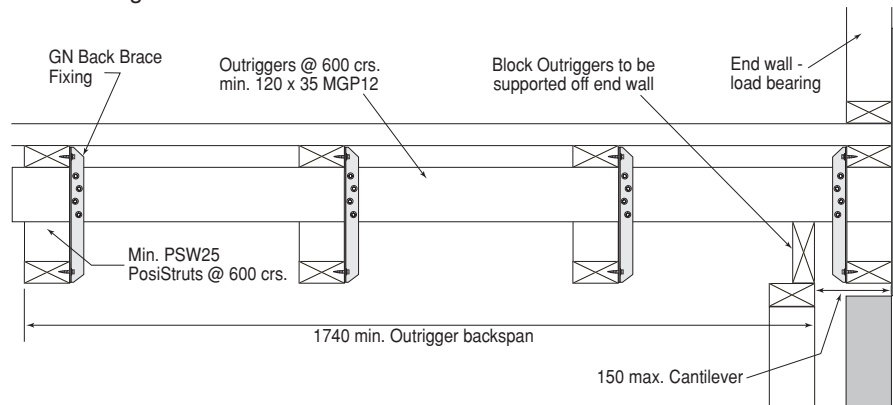


SECTION X-X

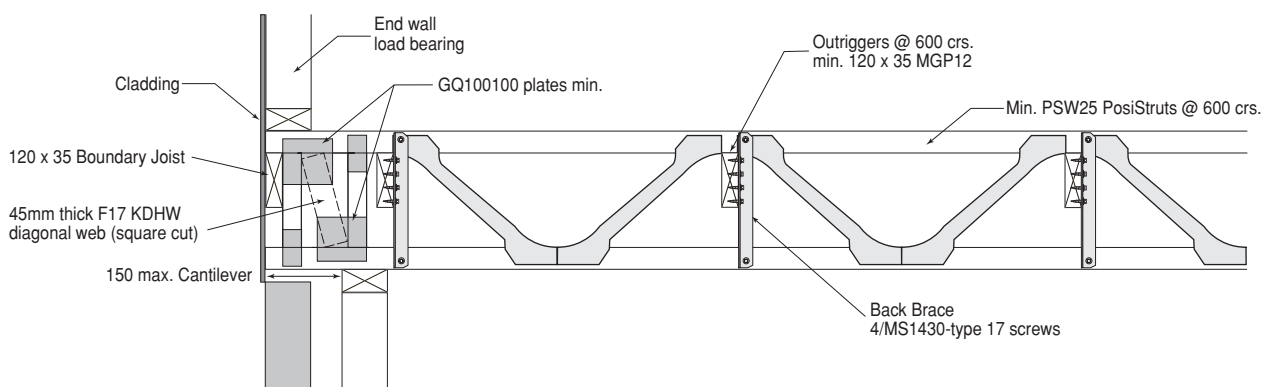


BRACING

End and Internal Support Bracing

Speedbrace bracing at 2400mm maximum centres along supporting walls.

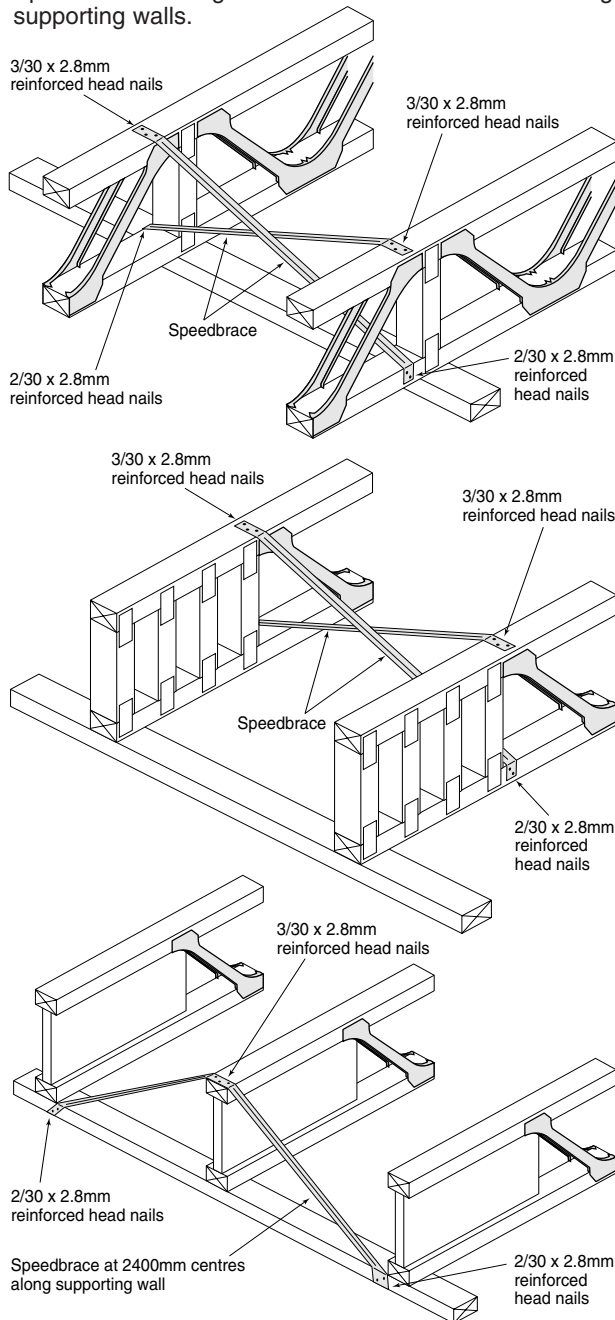


Plywood Panel at 2400mm maximum centres.

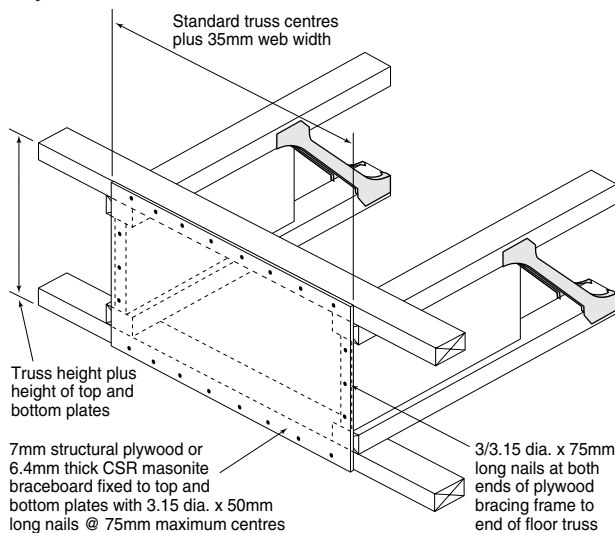


Alternative End and Internal Support Bracing


Plywood Bracing Frame at 2400mm maximum centres.

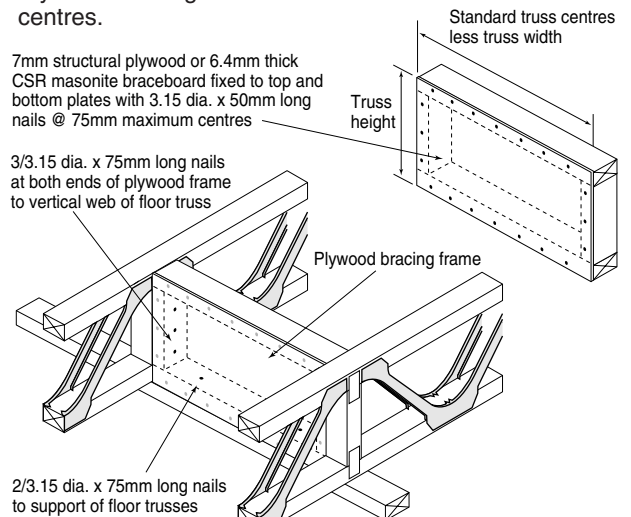


Timber Diagonal Bracing at 1800 mm maximum centres.

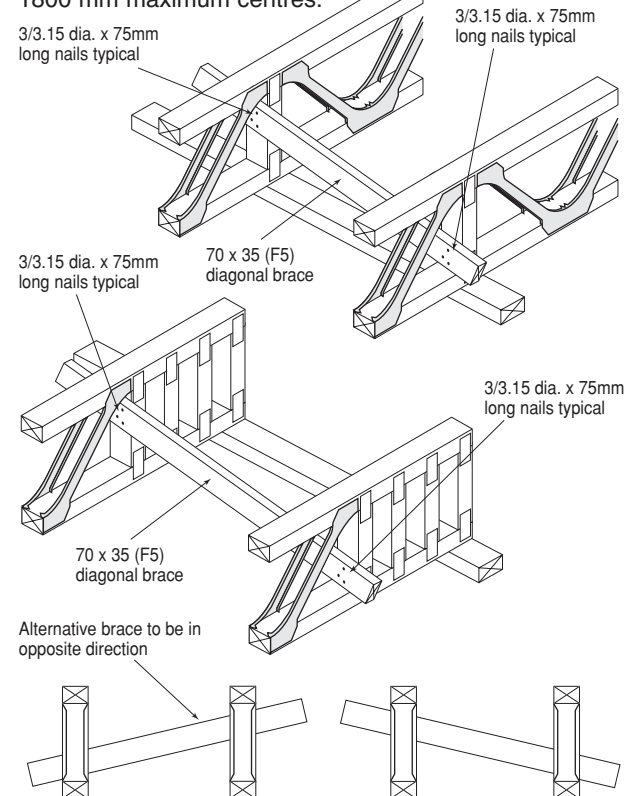

PosiPlus® offcut or seasoned timber blocking at 1800mm maximum centres.

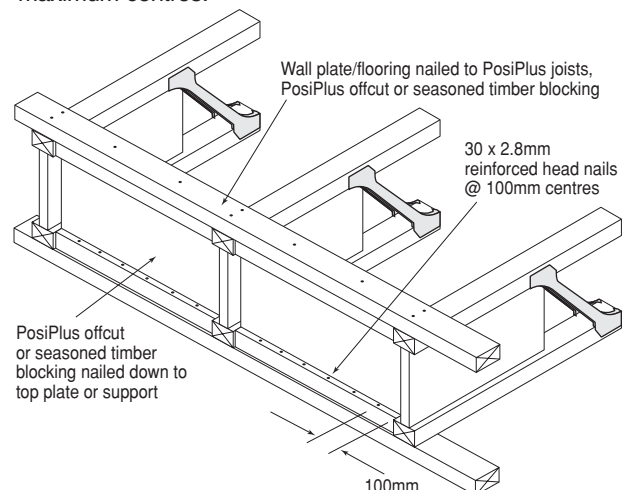

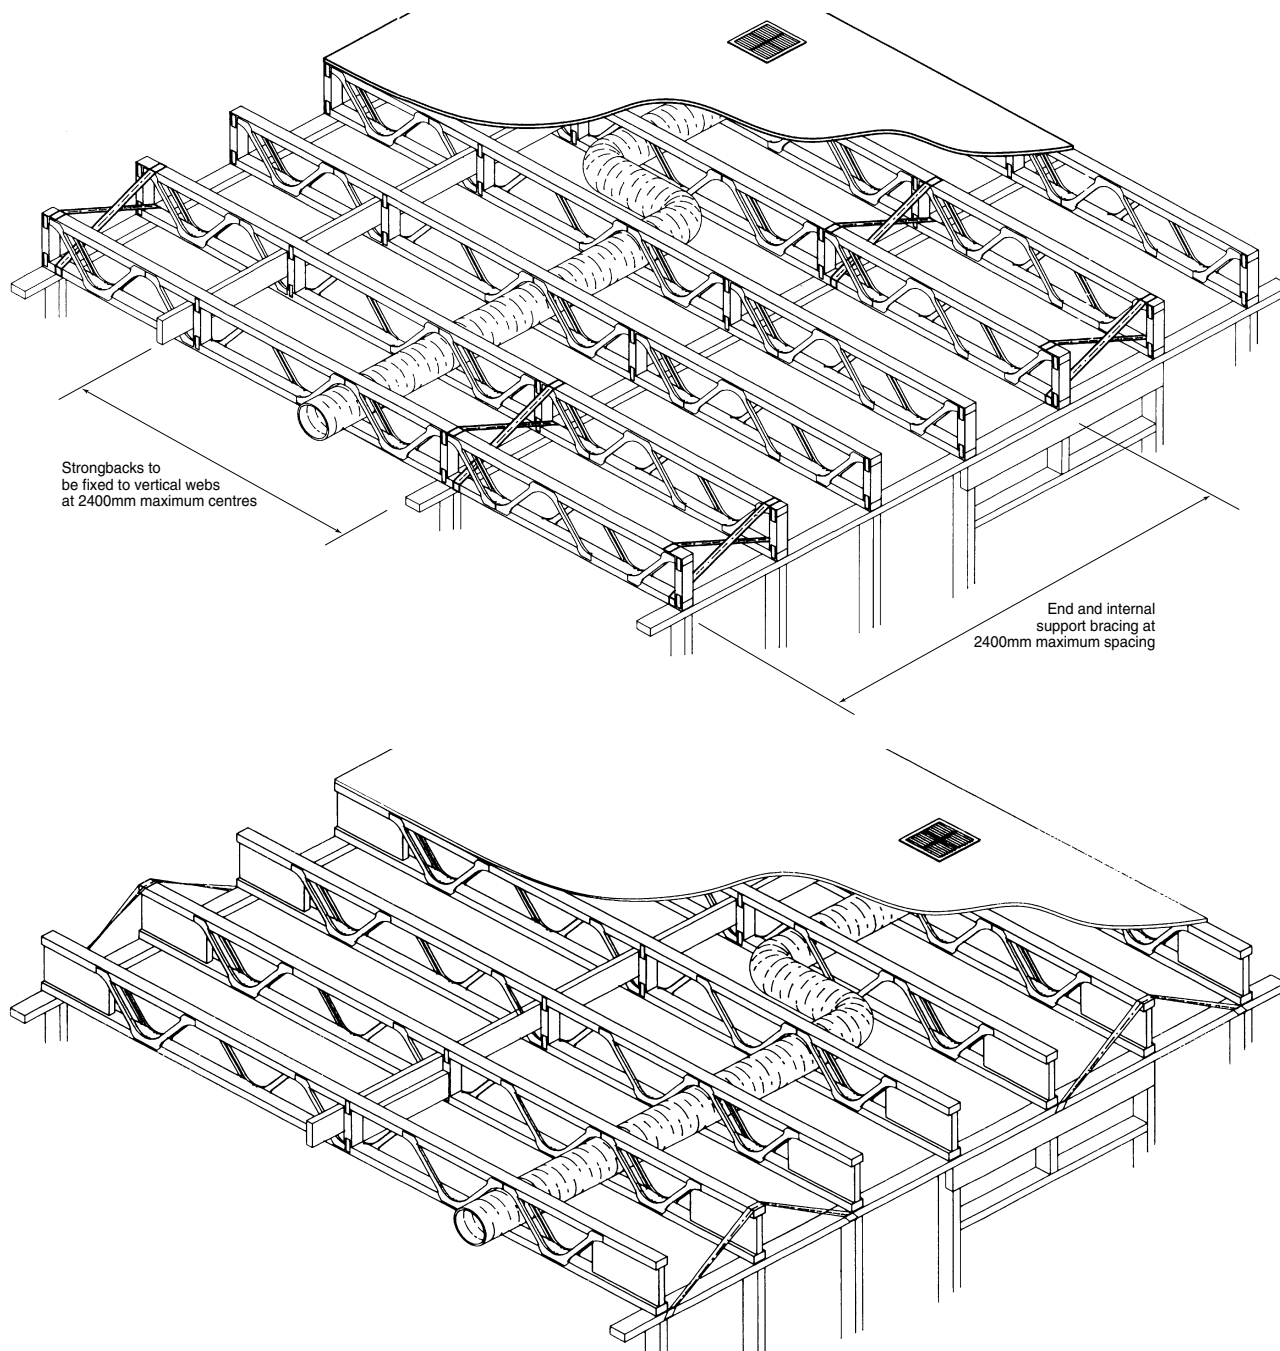

MECHANICAL SERVICES

PosiStrut® trusses allow mechanical service ducts and plumbing to be easily accommodated. Maximum clearance available for the different PosiStrut® depths is given in Table 18.

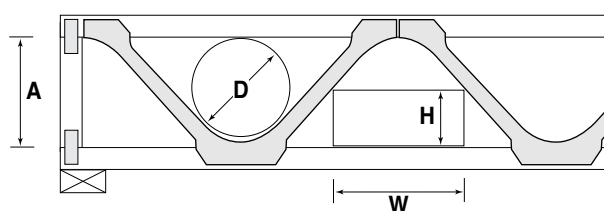


Table 18. Maximum Mechanical Service Clearances

PosiStrut® Size	Dimension A	Dimension D	Dimension H						
			50	75	100	125	150	175	200
			Dimension W						
PSW3520	127	120	280	200	120	-	-	-	-
PSW3525	178	170	320	280	230	180	140	-	-
PSW3530	232	220	350	310	280	240	210	170	130
PSW4525	158	150	310	260	200	150	60	-	-
PSW4530	212	200	340	300	260	210	170	130	70
PSW4536	270	245	480	440	390	350	300	250	200
PSW4540	322	280	490	460	410	370	330	300	250


PosiStrut® Roof Rafter & Purlin System

INTRODUCTION


PosiStrut® rafter and purlin details contained in this manual are only suitable for domestic construction. Although PosiStrut® rafters and purlins provide an economical solution for many commercial and light industrial buildings they need to be specifically designed for each building. For structures other than domestic buildings, consult MiTek Australia Ltd. or a licensed MiTek fabricator.

DEFINITION

PosiStrut® rafters are trusses placed parallel to roof pitch.

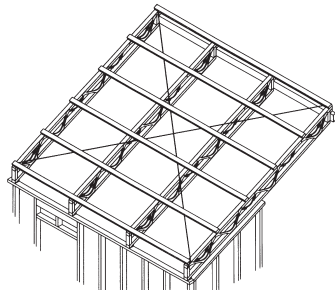

PosiStrut® purlins are trusses placed perpendicular to roof pitch.

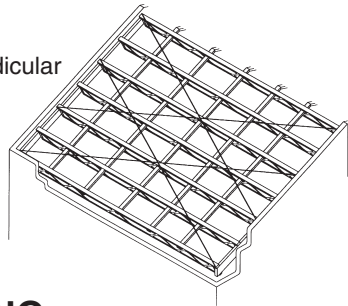

ROOF LOADING

PosiStrut® rafters and purlins have been designed to allow for the following loads.

Dead Loads

Dead loads are due to the weight of the roof structure and permanent fixtures. An allowance has been made for the following permanent loads.

1. Roof and ceiling material

- Terracotta tiles and 13mm plaster battened, maximum load 90kg/m²
- Concrete tiles and 13mm plaster battened, maximum load 80kg/m²
- Steel decking and 13mm plaster battened, maximum load 40kg/m²

2. Self weight of PosiStrut® rafters and purlins.

Provision for hot water units and air conditioning units have not been considered, Should there be the need for such services then contact MiTek Australia Ltd. engineers for advice.

Live Loads

Live loads are temporary loads due to maintenance of the roof structure. These loads are in accordance with AS/NZS1170.1.

Earthquake Loads

The PosiStrut® sizes, bracing and connection details are suitable for design category H1 and H2 domestic structures in accordance with AS1170.4.

Snow Loads

Snow loads of up to 0.2 kPa have been assumed in design for member sizes, bracing and connection.

Wind Loads

The PosiStrut® rafters and purlins have been designed according to AS/NZS1170.2 Wind Actions, AS4055 Wind Loads for Housing for the maximum design gust wind speed in Table 19.

Table 19. Maximum Design Gust Wind Speed			
Wind Classification	Design Gust Wind Speed (m/s)	Pressure coefficient	
	Ultimate Limit State (V_u)	External (C_{pe})	Internal (C_{pi})
N3	50	-0.9	0.2
N4	61	-0.9	0.2
C1	50	-0.9	0.7

CAMBER


Camber of span/300 or 20mm maximum should be set into each truss.

SET OUT AND PLACEMENT

PosiStrut® rafters and purlins have been designed for 600, 900, 1200, 1500 and 1800mm centres and in no case should the design maximum truss centres be exceeded.

PosiStruts® must be installed plumb and straight. Support location tolerance is 50mm with no reduced bearing. Check bearing strength where bearing area is reduced.

For top chord support, the gap between bearing and timber web must not exceed 6mm.

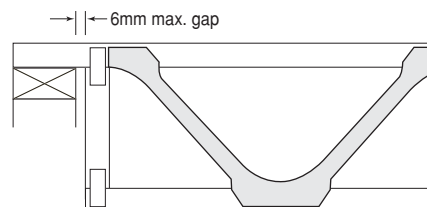

Sizes for battens or purlins used in conjunction with PosiStrut® rafters to be in accordance with AS1684 'Residential Timber-Framed Construction'.

PosiStrut® rafters and purlins used in open carports and garages may have higher criteria. In these situations consult MiTek Australia Ltd. engineers for further advice.

SIZES

The PosiStrut® rafters and purlins are available in four nominal sizes 200, 250, 300, 360 and 400mm depths.

As all PosiStrut® rafters and purlins are made to order, they are produced in the exact length required for the job.


HOLD DOWN DETAILS

Fixing types for various spans, spacing and roof covering are given in Table 20.

For more accurate assessment of hold down requirements on specific projects, refer to MiTek Australia Ltd. engineers.

Details for fixing wall plates to foundations to be by others. The supporting structure must also be designed by others to resist all vertical and horizontal loadings.

Top Chord Support Hold Down Detail

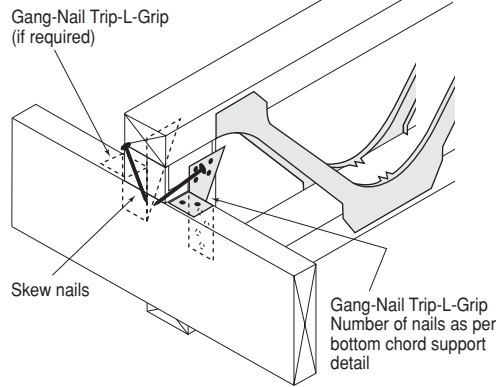

Bottom Chord Support Hold Down Detail

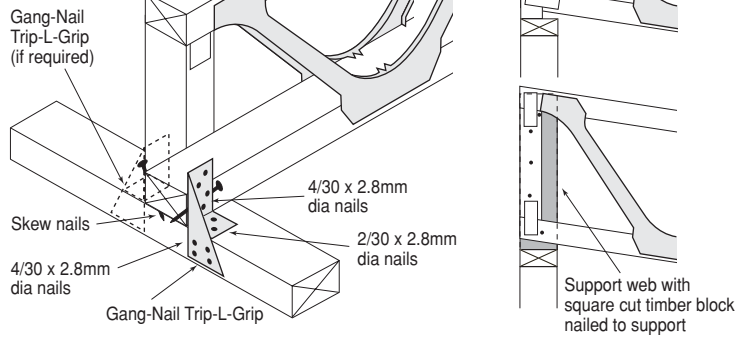



Table 20. Maximum Raked Span (mm)

Fixing type	Spacing (mm)									
	600		900		1200		1500		1800	
	Joint Group									
	JD4	JD3	JD4	JD3	JD4	JD3	JD4	JD3	JD4	JD3
Concrete tile with ceiling - Wind Classification N4 & C1										
1 Trip-L-Grip	6600	9000	4400	6000	3300	4500	-	-	-	-
2 Trip-L-Grips	13200	18000	8800	12000	6600	9000	-	-	-	-
Terracotta tile with ceiling - Wind Classification N4 & C1										
1 Trip-L-Grip	6900	9400	4600	6200	3400	4700	-	-	-	-
2 Trip-L-Grips	13800	18800	9200	12500	6900	9400	-	-	-	-
Sheet roof with ceiling - Wind Classification N3										
1 Trip-L-Grip	9000	12200	6000	8100	4500	6100	3600	4900	3000	4000
2 Trip-L-Grips	18000	20000	12000	16300	9000	12200	7200	9800	6000	8100
Sheet roof with ceiling - Wind Classification N4										
1 Trip-L-Grip	5600	7600	3700	5000	2800	3800	2200	3000	1800	2500
2 Trip-L-Grips	11200	15200	7400	10100	5600	7600	4500	6100	3700	5000
Sheet roof with ceiling - Wind Classification C1										
1 Trip-L-Grip	5700	7800	3800	5200	2800	3900	2300	3100	1900	2600
2 Trip-L-Grips	11500	15600	7600	10400	5700	7800	4600	6200	3800	5200


END AND INTERNAL SUPPORT BRACING

At external and internal supports, PosiStrut® rafters and purlins should be braced back to the top plate with the following:


1. Timber Diagonal Bracing (TDB) at 1200mm centres recommended for 300, 360 and 400mm PosiStrut® Rafters and Purlins

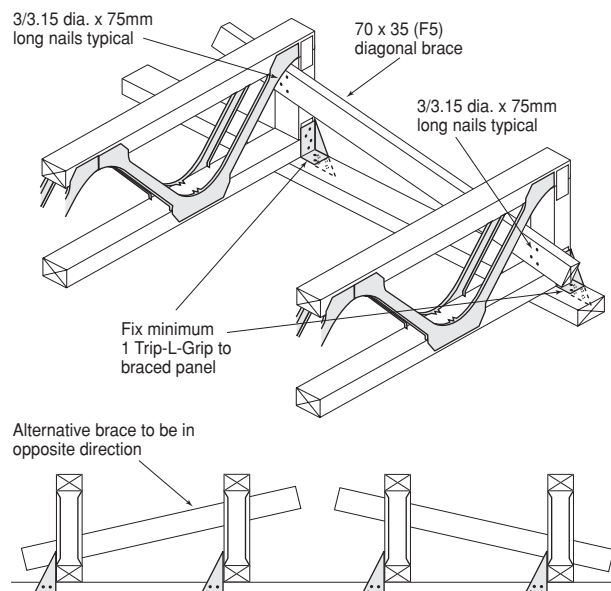

2. Plywood Bracing Frame (PBF) at 2400mm centres.

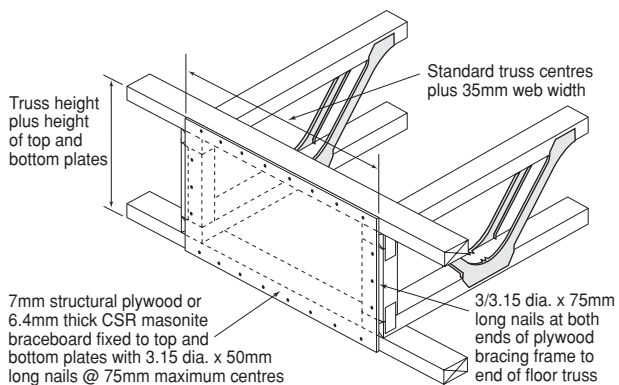

3. Gang-Nail Speedbrace (SB) at 2400mm centres.

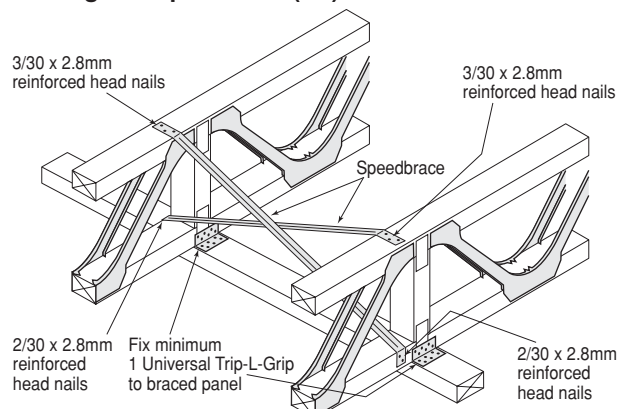

Note:


For top chord supported PosiStrut® trusses end panel bracing may be omitted if end web is fastened to end wall at bottom chord level.

HERRINGBONE BRACING

Use of Gang-Nail Bracing Strap to connect the top chord of one PosiStrut® to the bottom chord of the adjacent PosiStrut®. This type of bracing is to run continuously through the PosiStrut® trusses. Refer to detail below.

Herringbone bracing to be at least 3000mm maximum centres. For spans less than 3000mm herringbone bracing is not required.

For PSW4540 PosiStrut® trusses herringbone bracing should be spaced at 1800mm maximum centres.

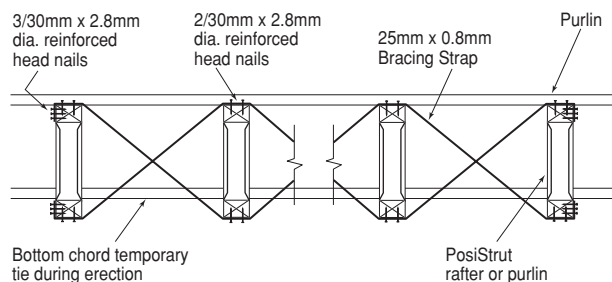**PERMANENT BRACING**

These recommendations assume the following:

- Wind Classification areas N4 and C1.
- Walls being stable in their own right.
- Roof spans as per Tables 21 to 25.
- Maximum truss centres - 1200mm for tiled and 1800mm for sheet roof.

LATERAL RESTRAINT**Top Chord**

For roofing battens or roofing purlins use sizes as required by AS1684 Residential Timber-Framed Construction, at 900mm maximum centres.

Bottom Chord

For ceiling battens or ceiling joists use sizes as required by AS1684 Residential Timber-Framed Construction at 900mm maximum centres.

For suspended ceilings or where ceiling battens do not provide restraint to bottom chords, eg. metal furring channels clipped to trusses, bottom chord ties may be required. Use 50 x 25 (F5) ties for trusses up to and including 900mm centres, and 70 x 35 (F5) ties for trusses at up to 1800mm centres. Fix ties to each truss with one 3.75mm diameter nail. Splice by lapping over adjacent trusses.

MAXIMUM SPAN CHARTS**Note:**

- All charts designed using LSD design method.
- Minimum Joint Group JD5.

Table 21. PosiStrut® Rafter & Purlin Maximum Spans

Maximum Raked Span for Domestic Roof Loading

- Steel Deck Roofing with Ceiling - 40kg/m²

- Wind Classification Area N3

- Bottom Chord Supported

Raked Span = Horizontal Span / Cos Ø Where, Ø = Roof Pitch

PosiStrut Size	Timber Size (mm x mm)	PosiStrut Centres (mm)														
		600			900			1200			1500			1800		
		Timber Stress Grade														
		F5	F8	F17	F5	F8	F17	F5	F8	F17	F5	F8	F17	F5	F8	F17
PSW3520	35 x 70	2400	4800	5500	1800	4100	4800	1800	3600	4300	1800	3300	3600	1700	2500	3100
	35 x 90	2600	5200	6000	2600	4500	5200	2500	4100	4400	2400	3600	3600	2400	3100	3100
PSW3525	35 x 70	3000	5500	6600	2500	4900	5700	1900	4500	5200	1900	4000	4800	1900	2900	4000
	35 x 90	4100	6200	7200	4100	5400	6200	3600	4900	5600	3100	4500	5300	2500	4200	4600
PSW3530	35 x 70	3700	6600	7700	3600	5700	6600	3000	5200	6000	2500	4600	5700	1900	3300	4500
	35 x 90	4900	7200	7700	4800	6300	7200	4200	5700	6700	3700	5200	5700	3200	4800	4800
PSW4525	45 x 70	4800	6000	7000	3700	5300	6100	3700	4800	5500	3600	4400	4900	2700	3300	4200
	45 x 90	6000	6600	7600	4900	5700	6600	4700	5200	5900	4400	4800	5000	3900	4200	4200
PSW4530	45 x 70	5100	7100	8100	4900	6200	7100	4300	5600	6400	4100	5200	5300	3100	3900	4500
	45 x 90	6800	7700	8800	6100	6700	7700	5600	6100	6500	5100	5300	5300	4500	4500	4500
PSW4536	45 x 70	5400	9100	10500	4600	8200	9300	3900	7200	8300	3900	6200	6500	3800	5500	5700
	45 x 90	7500	10000	11300	6700	8900	10000	6000	8100	8400	5400	6300	6500	4800	5700	5800
PSW4540	45 x 70	6100	10000	12500	5400	9000	10800	4600	7500	8200	2900	6600	6600	2800	5600	5600
	45 x 90	8300	11100	12500	7000	9800	10800	6500	8200	8200	5800	6600	6600	4600	5600	5600
		Timber Stress Grade														
		MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15
PSW3520	35 x 70	2900	5300	6500	1300	4300	5800	1300	4100	4500	1200	3500	3700	1100	3100	3100
	35 x 90	4100	6500	7000	3500	5400	5900	3100	4500	4500	3000	3700	3700	2500	3100	3100
PSW3525	35 x 70	3600	6000	7700	3100	5400	6900	1300	4700	6300	1300	4500	5300	1100	4000	4400
	35 x 90	4800	6800	8400	4300	6400	7400	3600	5900	6600	3600	5300	5400	3300	4600	4600
PSW3530	35 x 70	3700	6800	9100	3600	6100	7300	2400	5500	6900	1300	4900	5600	1300	4600	4700
	35 x 90	5600	8500	9800	5300	7600	8700	4300	6500	7000	4000	5600	5700	3500	4700	4700
PSW4525	45 x 70	4800	7300	8200	4300	6600	7200	3700	5700	6200	3600	5100	5100	3600	4300	4300
	45 x 90	6100	8300	8800	5500	7400	7800	4900	6200	6300	4600	5100	5100	4100	4300	4300
PSW4530	45 x 70	5900	8600	9600	5400	7500	8500	4800	6500	6700	4400	5400	5400	3700	4600	4600
	45 x 90	7000	9800	10200	6600	8700	8900	5800	6700	6700	5200	5500	5500	4600	4600	4600
PSW4536	45 x 70	6700	9900	10900	5400	8400	9600	5300	7100	8300	4600	6400	6700	3900	5600	5700
	45 x 90	7700	11200	11700	7000	9600	10400	6600	8200	8300	5600	6700	6800	5100	5700	5700
PSW4540	45 x 70	6900	10800	12100	6100	9000	10700	5600	7600	8100	5000	6600	6600	4600	5600	5600
	45 x 90	8600	12300	12900	8000	10300	10800	7100	8100	8200	6000	6600	6600	5600	5600	5600

Table 22. PosiStrut® Rafter & Purlin Maximum Spans

Maximum Raked Span for Domestic Roof Loading

- Steel Deck Roofing with Ceiling - 40kg/m²

- Wind Classification Area N4/C1

- Bottom Chord Supported

Raked Span = Horizontal Span / Cos Ø Where, Ø = Roof Pitch

PosiStrut Size	Timber Size (mm x mm)	PosiStrut Centres (mm)														
		600			900			1200			1500			1800		
		Timber Stress Grade														
		F5	F8	F17	F5	F8	F17	F5	F8	F17	F5	F8	F17	F5	F8	F17
PSW3520	35 x 70	2400	4200	4800	1800	3600	3700	1800	2900	2900	1700	2400	2400	1700	2100	2100
	35 x 90	3000	4500	5200	3000	3700	3700	2500	2900	2900	2400	2400	2400	2100	2100	2100
PSW3525	35 x 70	3000	5000	5700	2500	4300	4500	1900	3900	4300	1900	3300	3500	1900	2700	3000
	35 x 90	3900	5400	6200	3900	4700	4900	3400	4200	4300	2600	3500	3500	2200	3000	3000
PSW3530	35 x 70	3700	5800	6600	3600	5000	5300	3000	4500	4500	2500	3700	3700	1900	2900	3200
	35 x 90	4900	6300	6600	4600	5400	5800	4000	4500	4500	2900	3700	3700	2400	3200	3200
PSW4525	45 x 70	4800	5300	6100	3700	4600	4800	3500	3900	3900	3100	3300	3300	2600	2800	2800
	45 x 90	5200	5700	6600	4600	5000	5100	3900	3900	4000	3300	3300	3300	2800	2800	2800
PSW4530	45 x 70	5100	6200	7100	4700	5400	5400	4100	4200	4200	3300	3500	3500	2800	3000	3000
	45 x 90	6100	6700	7800	5300	5500	5500	4200	4200	4300	3500	3500	3500	3000	3000	3000
PSW4536	45 x 70	5400	7900	9900	4600	6400	6900	3100	5300	5300	1500	4400	4400	1500	3400	3700
	45 x 90	7000	9000	10000	5500	6900	6900	4600	5300	5300	3500	4400	4400	3000	3700	3700
PSW4540	45 x 70	6100	8600	9900	4500	6700	6700	3500	5200	5200	2400	4300	4300	1700	3600	3700
	45 x 90	7400	9900	9900	6100	6700	6700	4900	5200	5200	3900	4300	4300	3500	3700	3700
		Timber Stress Grade														
		MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15
PSW3520	35 x 70	2900	4500	5400	1300	3700	3700	1300	2900	2900	1200	2500	2500	1100	2100	2100
	35 x 90	4100	5400	5400	3600	3700	3700	2900	2900	2900	2400	2500	2500	2000	2200	2200
PSW3525	35 x 70	3600	5700	7300	3100	4700	5500	1300	4000	4300	1300	3200	3500	1100	2700	3000
	35 x 90	4800	6600	7300	4000	5400	5600	3400	4300	4300	2600	3500	3500	2100	3000	3000
PSW3530	35 x 70	3700	6500	8200	3200	5300	5900	2400	4400	4500	1300	3700	3700	1300	2900	3200
	35 x 90	5600	7600	8600	4700	5900	5900	3800	4500	4500	2800	3700	3700	2500	3200	3200
PSW4525	45 x 70	4800	6500	7600	4200	5200	5200	3400	4000	4000	3000	3400	3400	2500	2900	2900
	45 x 90	5900	7400	7600	4600	5200	5200	4000	4000	4000	3400	3400	3400	2900	2900	2900
PSW4530	45 x 70	5900	7300	8200	4500	5500	5500	4000	4300	4300	3300	3500	3500	2800	3000	3000
	45 x 90	6600	8200	8200	5300	5500	5500	4300	4300	4300	3500	3500	3500	3000	3000	3000
PSW4536	45 x 70	6100	8100	9900	5200	6500	6900	4300	5300	5300	3300	4400	4400	2800	3800	3800
	45 x 90	7200	9100	9900	5700	6900	6900	5000	5300	5300	3900	4400	4400	3300	2800	3800
PSW4540	45 x 70	6900	8600	9900	5400	6700	6700	4400	5200	5200	3300	4300	4300	2600	3700	3700
	45 x 90	7900	9900	9900	6300	6700	6700	5200	5200	5200	4100	4300	4300	3500	3700	3700

Table 23. PosiStrut® Rafter & Purlin Maximum Spans

Maximum Raked Span for Domestic Roof Loading

- Concrete Tile Roofing with Ceiling - 80kg/m²

- Wind Classification Area N3, N4 & C1

- Bottom Chord Supported

Raked Span = Horizontal Span / Cos Ø Where, Ø = Roof Pitch

PosiStrut Size	Timber Size (mm x mm)	PosiStrut Centres (mm)								
		600			900			1200		
		Timber Stress Grade								
		F5	F8	F17	F5	F8	F17	F5	F8	F17
PSW3520	35 x 70	1900	3600	4800	1700	3300	4100	1700	3200	3300
	35 x 90	3000	4500	5200	2400	4000	4000	2400	3300	3300
PSW3525	35 x 70	2500	4300	5700	1900	3700	5000	1800	3400	4500
	35 x 90	3600	5400	6200	3100	4600	5400	2500	4100	5000
PSW3530	35 x 70	3100	5000	6600	2500	4500	5800	2400	4000	5200
	35 x 90	4300	6300	6600	3700	5400	6400	3100	4900	5200
PSW4525	45 x 70	3700	5300	6100	3100	4600	5300	3000	4100	4500
	45 x 90	4800	5700	6600	4200	5000	5700	3700	4500	4600
PSW4530	45 x 70	4800	6200	7100	3700	5400	6200	3300	4800	4900
	45 x 90	5500	6700	7700	4900	5800	6400	4500	4900	4900
PSW4536	45 x 70	3900	7500	8600	2900	6600	7500	-	5600	6300
	45 x 90	6000	8100	9300	5300	7100	7900	4500	6200	6300
PSW4540	45 x 70	5300	8000	9500	3000	7200	8000	-	6000	6200
	45 x 90	6800	9000	10200	5300	7900	8100	4200	6200	6200
		Timber Stress Grade								
		MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15
PSW3520	35 x 70	2400	3700	5200	1100	3500	4200	1100	3000	3400
	35 x 90	3200	4900	5700	3000	4100	4200	2400	3400	3400
PSW3525	35 x 70	3000	4800	6300	1100	4000	5600	1100	3500	5100
	35 x 90	4100	5900	6800	3600	5200	6000	3100	4700	5100
PSW3530	35 x 70	3600	5600	7400	1100	4800	6500	1100	4100	5300
	35 x 90	4400	7100	7900	3900	6000	7000	3500	5300	5300
PSW4525	45 x 70	3700	6000	6600	3600	5000	5800	3200	4600	4700
	45 x 90	4900	6800	7200	4300	5800	5800	4000	4700	4700
PSW4530	45 x 70	4800	6800	7800	4200	6000	6600	3700	5100	5100
	45 x 90	5600	7900	8400	5000	6600	6700	4600	5100	5100
PSW4536	45 x 70	5300	8100	8900	4500	6600	7700	3900	5800	6300
	45 x 90	6700	9100	9600	5500	7500	8000	5100	6300	6300
PSW4540	45 x 70	6000	8700	9800	5200	7300	8000	3900	6100	6200
	45 x 90	7400	9900	10500	6400	8000	8000	5700	6200	6200

Table 24. PosiStrut® Rafter & Purlin Maximum Spans

Maximum Raked Span for Domestic Roof Loading

- Terracotta Tile Roofing with Ceiling - 90kg/m²

- Wind Classification Area N3, N4 & C1


- Bottom Chord Supported

Raked Span = Horizontal Span / Cos Ø Where, Ø = Roof Pitch

PosiStrut Size	Timber Size (mm x mm)	PosiStrut Centres (mm)								
		600			900			1200		
		Timber Stress Grade								
		F5	F8	F17	F5	F8	F17	F5	F8	F17
PSW3520	35 x 70	1900	4100	4800	1700	3100	3800	1700	2500	3000
	35 x 90	2600	4300	5100	2400	3800	3700	2300	3000	3000
PSW3525	35 x 70	2400	4300	5700	1900	3900	5000	1800	3300	4500
	35 x 90	3600	5300	6200	3000	4600	5400	2500	4000	4700
PSW3530	35 x 70	3000	4900	6600	2500	4500	5800	2400	3900	5100
	35 x 90	4200	6300	6600	3600	5300	6400	3100	4800	5000
PSW4525	45 x 70	3600	5300	6100	3100	4600	5300	2900	4100	4500
	45 x 90	4800	5700	6600	4100	5000	5600	3600	4500	4500
PSW4530	45 x 70	4300	6200	7000	3700	5300	6200	3300	4700	5000
	45 x 90	5400	6700	7500	4800	5800	6200	4200	5000	4900
PSW4536	45 x 70	3900	7000	8300	2800	6100	7200	-	5200	5800
	45 x 90	6000	7800	8900	4700	6800	7300	3900	5800	5800
PSW4540	45 x 70	4600	8000	9100	2900	6600	8000	-	5400	6500
	45 x 90	6700	8700	9800	5300	7600	8300	4000	6500	6500
		Timber Stress Grade								
		MGP10	MGP12	MGP15	MGP10	MGP12	MGP15	MGP10	MGP12	MGP15
PSW3520	35 x 70	2300	3700	5100	1100	3200	3900	1100	2700	3100
	35 x 90	3100	4700	5200	2900	3900	3800	2400	3100	3100
PSW3525	35 x 70	2500	4800	6100	1100	4000	5400	1100	3000	4800
	35 x 90	4100	5800	6600	3600	5200	5900	3100	4500	4700
PSW3530	35 x 70	3600	5500	7100	1100	4700	6200	1100	4100	5100
	35 x 90	4400	6900	7700	3900	5900	6400	3200	4900	5100
PSW4525	45 x 70	3700	5900	6400	3500	4900	5600	3100	4300	4700
	45 x 90	4800	6600	6900	4300	5700	5800	3700	4700	4600
PSW4530	45 x 70	4800	6800	7500	4100	5700	6500	3600	4900	5100
	45 x 90	5600	7600	8100	4900	6400	6500	4500	5100	5100
PSW4536	45 x 70	5200	7600	8500	4500	6300	7400	3800	5500	5800
	45 x 90	6600	8600	9200	5400	7200	7400	4600	5800	5800
PSW4540	45 x 70	5500	8100	9500	4600	6800	8300	3900	5900	6500
	45 x 90	7000	9400	10200	5800	7700	8300	5100	6500	6500

SPEEDBRACE FIXING

ROOF BRACING - PosiStrut Rafters - Trusses are placed parallel to roof pitch.

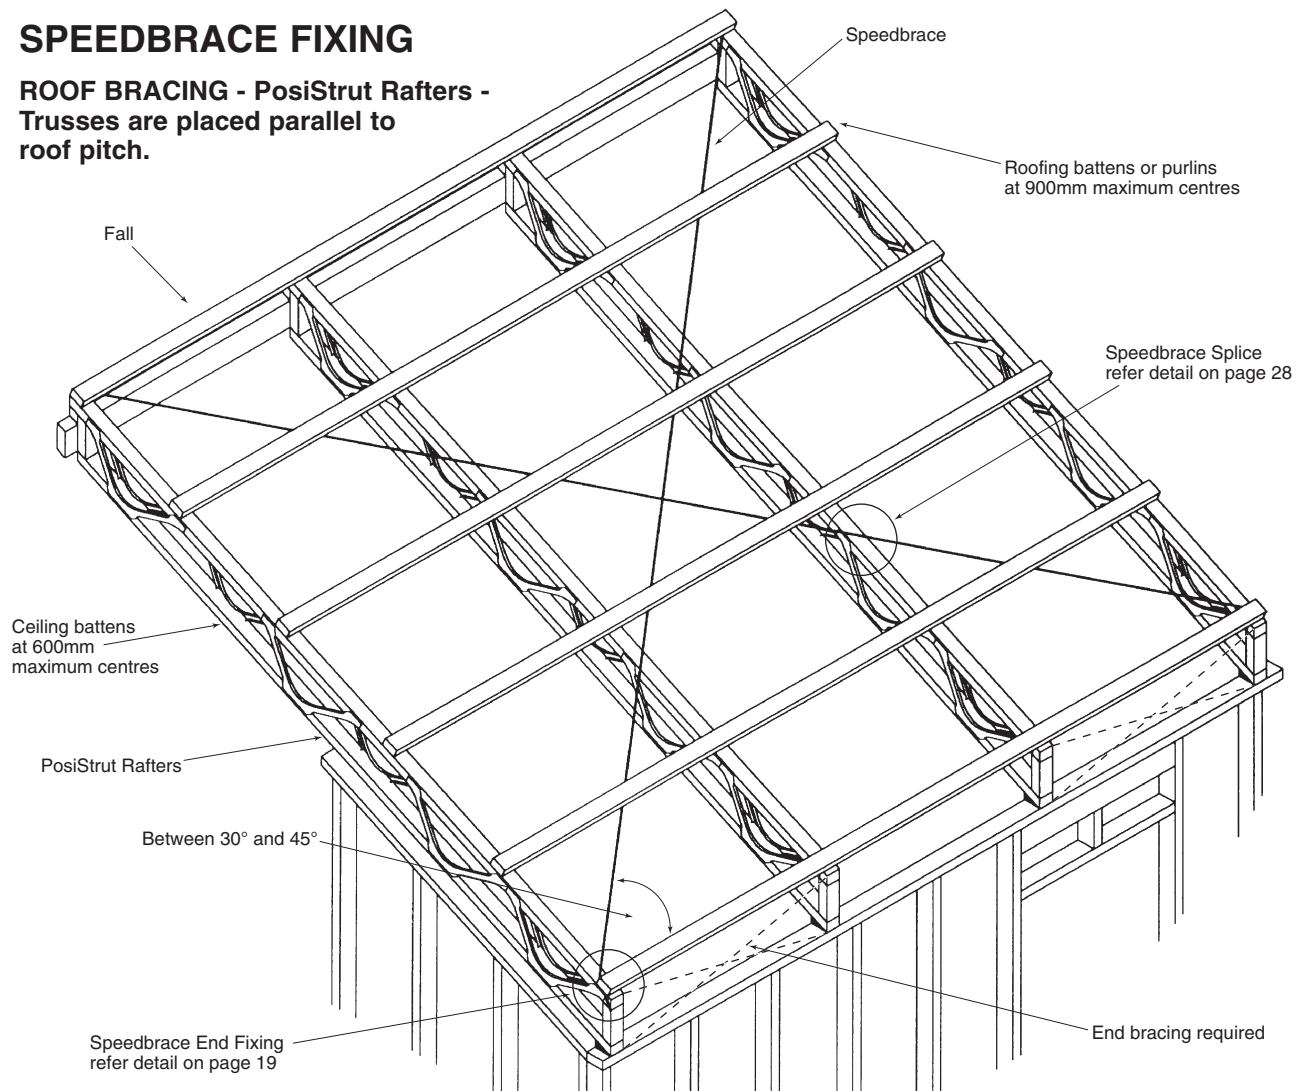

Top Chord Bracing

The top chord bracing shall be arranged according to the following roof lengths using single Speedbrace.

Bottom Chord Bracing


Adopt similar batten and bracing arrangement as the top chord for trusses with suspended ceiling or exposed bottom chords.

Note:


The following bracing details are designed for the stability of PosiStrut® truss only. The stability of supporting and end walls should be checked by others.

a) Roof length 'L' is less than truss span 'S'


Where the roof length 'L' is very short compared to the span 'S' such that it would result in a brace angle greater than 45°, a diagonal bracing arrangement is required as given below. Bracing bays should be spaced across the roof such that the angle is always between 30° and 45°.

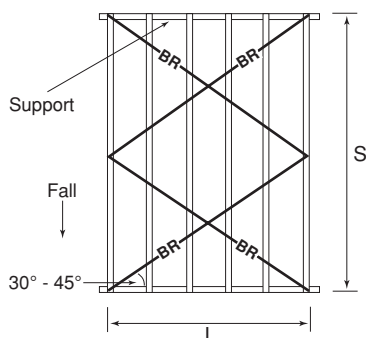


b) Roof length 'L' is 1 to 1.5 times the truss span 'S'

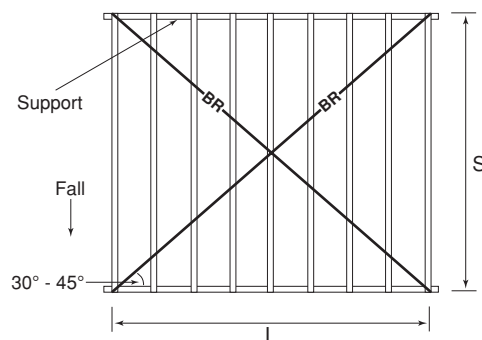

c) Roof length 'L' is long compared to the truss span 'S'

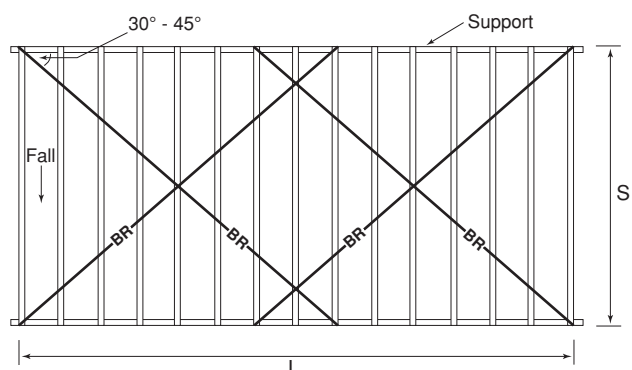

ROOF BRACING - PosiStrut Purlins - Trusses
are placed perpendicular
to roof pitch.

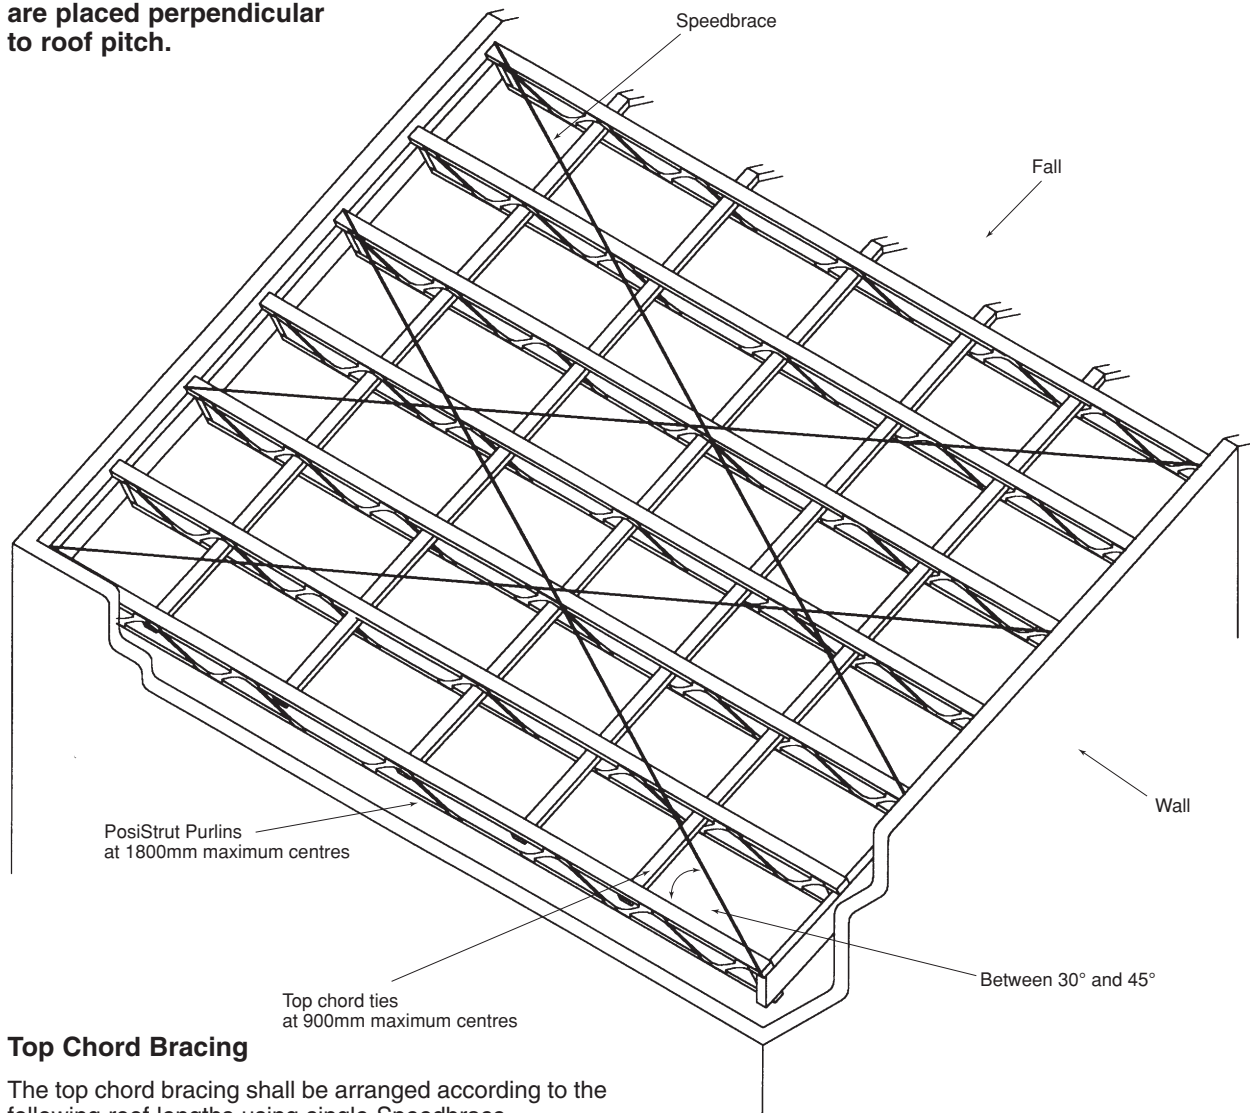

Top Chord Bracing

The top chord bracing shall be arranged according to the following roof lengths using single Speedbrace.

Bottom Chord Bracing


Adopt similar tie and bracing arrangement as the top chord for trusses with suspended ceiling or exposed bottom chords.

Note:


The following bracing details are designed for the stability of PosiStrut® truss only. The stability of supporting and end walls should be checked by others.

a) Roof length 'L' is less than truss span 'S'

Where the roof length 'L' is very short compared to the span 'S' such that it would result in a brace angle greater than 45°, a diagonal bracing arrangement is required as given below. Bracing bays should be spaced across the roof such that the angle is always between 30° and 45°.

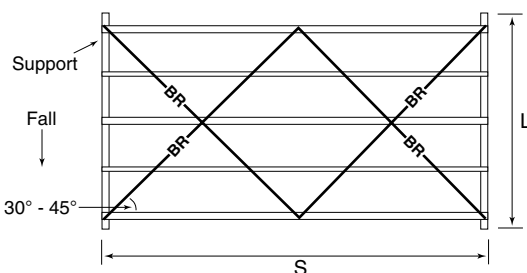


b) Roof length 'L' is 1 to 1.5 times the truss span 'S'

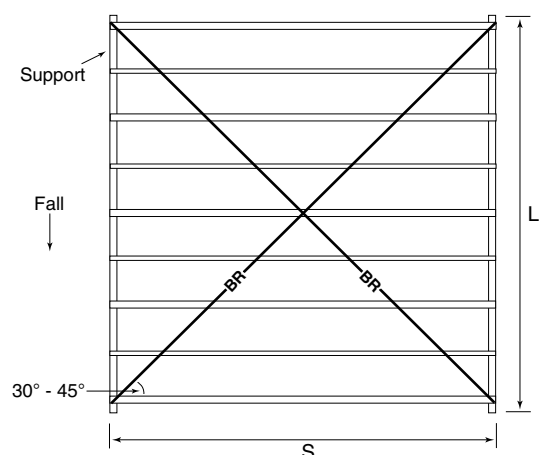


For PosiStrut purlins with span greater than 4000mm, double Speedbrace shall be used.


c) Roof length 'L' is long compared to the truss span 'S'

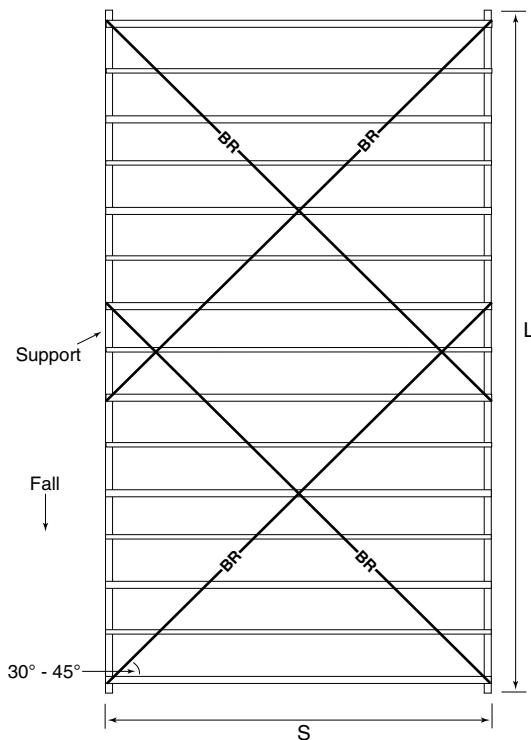

Typical End Fixing Detail

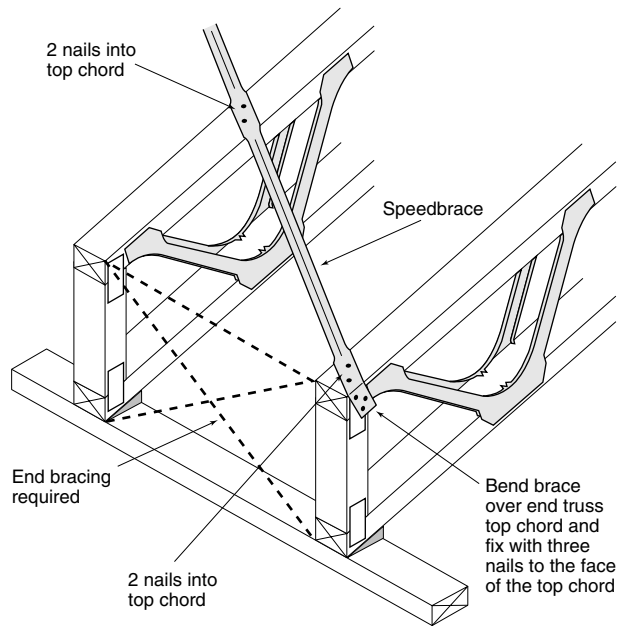

Typical Splice Detail

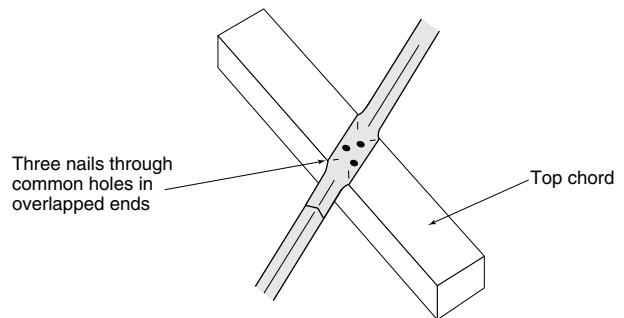

PRODUCT CERTIFICATION

All MiTek products specified in this guideline are engineered building products that have been designed, developed and tested in the corporate engineering laboratory of MiTek Australia to comply with the requirements of the Building Code of Australia. The design values, applications and specifications of these products are certified by qualified chartered engineers and they are published in individual product brochures freely available on the MiTek website. Further information, support and guidance on any of these products may be obtained by contacting one of our offices listed below.



MiTek Australia Ltd. ABN 98 004 564 587

GN007-3/12

Victoria

46 Monash Drive
Dandenong Sth 3175
Tel: (03) 8795 8888
Fax: (03) 9702 9464

New South Wales

5/100 Belmore Rd
Riverwood 2210
Tel: (02) 8525 8000
Fax: (02) 8525 8050

Queensland

17 Eagleview Place
Eagle Farm 4009
Tel: (07) 3861 2100
Fax: (07) 3861 2199

South Australia

5/348 Richmond Rd
Netley 5037
Tel: (08) 8234 1326
Fax: (08) 8213 2554

Western Australia

38-40 Magnet Road
Canningvale 6155
Tel: (08) 6218 5945
Fax: (08) 6218 5946

New Zealand

Tel: (09) 274 7109

Malaysia

Tel: (603) 3176 7473

VISIT OUR WEB SITE: www.mitek.com.au